


AGRO Ex cable glands.

Professional cable glands for potentially explosive atmospheres.



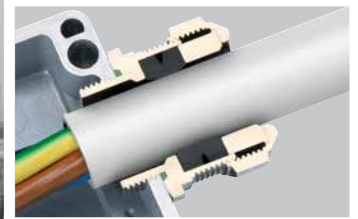

Explosion protection.

Necessary more frequently than you might think.

In the 19th century, electrical technology made its way into both industry and the home. Immediately thereafter, the first fundamentals for protection against electrical explosions were developed because of the methane gas and coal dust which arose during the mining of anthracite coal. The advantages of electricity were so overwhelming that people started working intensively to come up with ways to prevent any possible meeting of explosive atmospheres and ignition sources – resulting from the use of electrical equipment – and in this way could avoid explosions.

This application in mining was just the start. The chemical and petrochemical industries as well as oil and gas extraction represent more application areas where explosion-proof equipment is needed. Additionally, organic chemistry, the paint and varnish industry as well as the pharmaceuticals industry all process and work with flammable liquids and gases. And today even more application areas are constantly emerging, for instance with the extraction and use of biogas or the ecological use of disposal sites and landfills. In the processing of wood and grain there are yet more potential sources of danger. The use of hydrogen is being discussed intensively, and here, too, this will lead to various applications requiring explosion protection.

Anyone who is involved professionally with industrial systems must now be very conscious about the topic of explosion protection. In many industries, gases, vapours or mists build up or escape during the manufacture, processing, transport or storage of combustible materials, and these are released into the environment. Combustible dust is created in other processes. When these are combined with oxygen in the air, a hazardous atmosphere can build up which if ignited results in an explosion.

Explosion protection is governed by the legislation of individual countries around the world. Differences in technical requirements specific to each country and the required permits for explosion-proof equipment place high requirements on manufacturers, especially those with global operations, and these result in high costs for product development and approvals processes. In the wake of globalisation, though, it has been possible to make great strides towards uniform policies for explosion protection.



Sugar dust explosion at Port Wentworth

	Directives and regulations		4 - 5
	General information about explosion protection		6 - 7
Flameproof enclosure Ex d IIC	If there is any ignition inside the enclosure, it withstands the pressure – the explosion does not spread outside the unit.	Series 18 Ex Compact MS	8 - 9 10 - 11
Increased safety Ex e II	The equipment or its components prevent the ignition of an explosive atmosphere within the enclosure.	Ex Compact MS Progress® MS EX Progress® MS Multi EX Progress® MS KB EX Progress® MS T + KB Progress® MS EMV Rapid EX Progress® MS EMV EX Progress® MS EMV KB EX Progress® MS Kombi EX Pressure balance elements Progress® GFK EX Progress® GFK Multi EX	11 12 - 14 15 16 - 17 18 19 20 21 22 23 24 - 26 27 - 28
Intrinsic safety Ex i II	Limiting the energy in electrical circuits prevents the development of excessively high temperatures, sparks or electric arcs.	Progress® GFK EX	29 - 30
	Accessories, certificates		31



Directives and regulations

Directive 2014/34 EC

The new directives 2014/34/EC of the European Parliament and of the Council of 26 February 2014 on the harmonisation of the laws of the Member States address manufacturers and users of equipment and protective systems for use in potentially explosive atmospheres.

Since 20 April 2016 only products approved according to the new directions and with EC declaration of conformity can be brought to the market. The old certificates according to the former directives 94/9/EC remain valid. A recertification according to the directives 2014/34/EU is not necessary.

IECEX

The international IECEx scheme likewise serves for the conformity assessment and certification of equipment, systems and services for use in potentially explosive atmospheres.

Introduced in 1996, the IECEx system supports the international harmonisation of standards and the issue of country- and region-neutral certificates of conformity (CoC) to simplify the free movement of goods around the world. There is already an extensive agreement between the European ATEX directives and the IECEx regulations as regards classes and requirements. This all means that ATEX could one day be replaced.

In those countries which recognise IECEx, certified equipment, apparatus and systems can be put into service without additional tests.

Today, IECEx is recognised not only in Europe but in many additional countries including Australia, New Zealand, Brazil, Canada, China, Japan, Korea, Malaysia, Singapore, South Africa, USA...

You can find further information about the IECEx system and its rules as well as regulations, handbooks and procedures at www.iecex.com.

“Equipment” refers to machines, apparatus, fixed or mobile devices, control components and instrumentation thereof and detection or prevention systems which, separately or jointly, are intended for the generation, transfer, storage, measurement, control and conversion of energy for the processing of materials and which are capable of causing an explosion through their own potential sources of ignition.

“Components” refers to any item essential for the safe functioning of equipment and protective systems but with no autonomous function.

An **“explosive atmosphere”** is a mixture with air, under atmospheric conditions, of flammable substances in the form of gases, vapours, mists or dusts in which, after ignition has occurred, combustion spreads to the entire unburned mixture.

A **“potentially explosive atmosphere”** is one which could become explosive due to local and operational conditions.

The manufacturer must take great care to provide sufficient information and instructions necessary for the proper operation and maintenance of equipment.



Prerequisites for certification

In the annex of directives 2014/34 EC various modules for the commercialisation of equipment intended for use in potentially explosive atmospheres are defined. Modules III and IV are often used and applied at AGRO as well, and from them two certificates result:

- **EC type-examination certificate**
- **Recognition of production quality assurance**

Both certificates are issued by accredited testing facilities after tests have been successfully completed.

EC type-examination certificate

The EC type-examination certificate is the document which is issued on the base of successfully passed technical testing according to the requirements of module B.

Recognition of production quality assurance

Module D demands tested and monitored production. It ensures that products placed on the market are identical with the test samples used for the EC type-examination certificate. The quality management system must be tested and certified according to EN/ISO/IEC 80079-34.

CE declaration of conformity

The CE declaration of conformity is based on the EC type-examination certificate and QS approval. With it, a manufacturer declares that it has observed all applicable standards, instructions and regulations. This is made visible with the CE symbol, which is a part of the marking.

Standards

Numerous standards which address explosion protection exist around the world. The scope of standards is, however, subject to continuous updates which reflect technical advances and increased societal requirements regarding safety. International harmonisation efforts around the world have as their goal globally unified safety standards to help break down trade barriers.

Equipment is differentiated by the corresponding series of standards:

IEC/EN 60079	for electrical equipment (gases, vapours and dust)
EN 13463	for non-electrical equipment (will in future be replaced by EN 80079)

Which type of ignition protection a manufacturer selects depends on the type and intended function of the equipment. All standardised types of ignition protection within a given category are equivalent. A manufacturer confirms with the EC type-examination certificate, which belongs to the technical documentation, that its product conforms to ATEX directives.

Certification

Equipment intended for use in potentially explosive atmospheres may only be brought to market if they have undergone the conformity assessment procedures dictated in the directives. EC type-examination certifications from a designated European testing facility are recognised within the entire EC.


Conditions for an explosion

As a rule, an explosion can only take place in atmospheric air if three factors come together:



- a flammable material
- oxygen (in the air)
- ignition source

The first two factors – flammable material and air – must be present in a corresponding concentration so that they can form an explosive atmosphere. Descriptions of explosion protection are thus in general limited to the depiction of reactions with oxygen in air. Oxidation reactions which are generally associated with the generation of heat and pressure fulfil the criteria for an explosion.

Hazardous areas for explosions can develop in manufacturing facilities and workplaces. Typical hazardous areas arise in chemical factories, refineries, paint factories, paint shops, cleaning systems, mills/warehouses for milled products, commercial bakeries and other places with combustible dusts, in tank farms and loading facilities for combustible gases, liquids and solids.

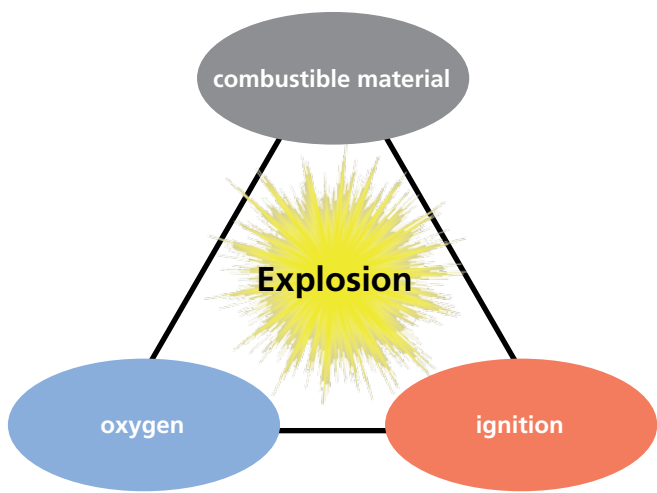

Examples for zone assignment in the Ex area

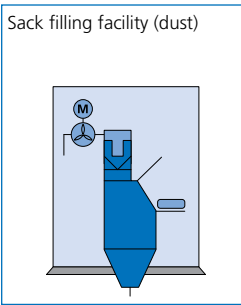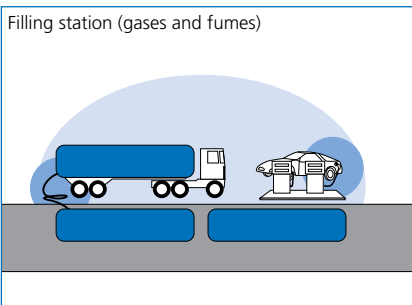

Zone assignment						
	Gas			Dust		
	Zone 0	Zone 1	Zone 2	Zone 20	Zone 21	Zone 22
Frequency of explosion hazard	continually or long-term	occasionally	seldom and short-term	same as Zone 0 Dust deposits alone do not make up Zone 20	same as Zone 1	same as Zone 2 or if accumulations of dust are present
Frequency of ignition sources from electrical equipment	never (even not during seldom operating malfunctions)	very seldom (even not if frequent operating malfunctions can be expected)	gelegentlich (z.B. bei Betriebsstörung)	same as Zone 0	same as Zone 1	same as Zone 2

What protective measures can be taken to reduce the danger of explosion?

- avoid combustible substances
- inerting (addition of nitrogen, carbon dioxide, etc.)
- limiting concentration levels
- improved ventilation
- secondary explosion protection is necessary if the danger of explosion cannot be ruled out through primary explosion protection measures

Equipment marking

The following can be identified from the marking of electrical equipment for hazardous areas:

- equipment manufacturer
- a designation from which it can be identified
- the area of use: - underground I - other areas II
- the categories which indicate if the device can be used in certain areas
- the type(s) of ignition protection which the equipment fulfils
- the overall identification of the certificate

M – this prefix stands for underground mines
G – this suffix stands for combustible gases, mists or vapours
D – this suffix stands for dust

Numerals express the degree.

- Equipment category 1** very high degree of safety
- Equipment category 2** high degree of safety
- Equipment category 3** normal degree of safety

- Equipment protection level a** very high degree of protection and thus a very high degree of safety
- Equipment protection level b** high degree of protection and thus a high degree of safety
- Equipment protection level c** normal degree of protection and thus an increased level of safety

This results in the assignment of the equipment categories to the zones.



Explosion groups

Within the explosion groups, for electrical equipment a first distinction is made between Equipment Group I and Equipment Group II. Electrical equipment in Equipment Group I is used for mines susceptible to firedamp. For electrical equipment in Equipment Group II, a further subdivision is made into explosion groups. The subdivision depends on the


maximum experimental safe gap (MESG) and the minimum ignition current. Electrical equipment with approval for Explosion Group IIC may also be used in Explosion Groups IIA and IIB. Electrical equipment in Equipment Group III is likewise subdivided into further explosion groups.

Explosion groups				
Equipment group	Application examples	Gas/dust group	Explosion group	MESG with flameproof enclosure
Group I	Electrical equipment for mines susceptible to firedamp → Firedamp protection Ex ...I			
Group II	Electrical equipment for areas which are hazardous due to explosive gases → Explosion protection Ex...II	IIA (e.g. propane)	IIA	> 0.9 mm
		IIB (e.g. ethylene)	IIB	0.5 bis 0.9 mm
		IIC (e.g. hydrogen)	IIC	< 0.5 mm
Group III	Electrical equipment for areas which are hazardous due to explosive dust → Explosion protection Ex ...III	IIIA (e.g. combustible flakes)	IIIA	
		IIIB (e.g. non-conductive dust)	IIIB	
		IIIC (e.g. conductive dust)	IIIC	

For Group II equipment a further subdivision is made into explosion groups and temperature classes.


Assignment in temperature classes		
Temperature class	Ignition temperature	Max. surface temperature of the equipment
T1	≥ 450 °C	450 °C
T2	300-450 °C	300 °C
T3	200-300 °C	200 °C
T4	135-200 °C	135 °C
T5	100-135 °C	100 °C
T6	85-100 °C	85 °C



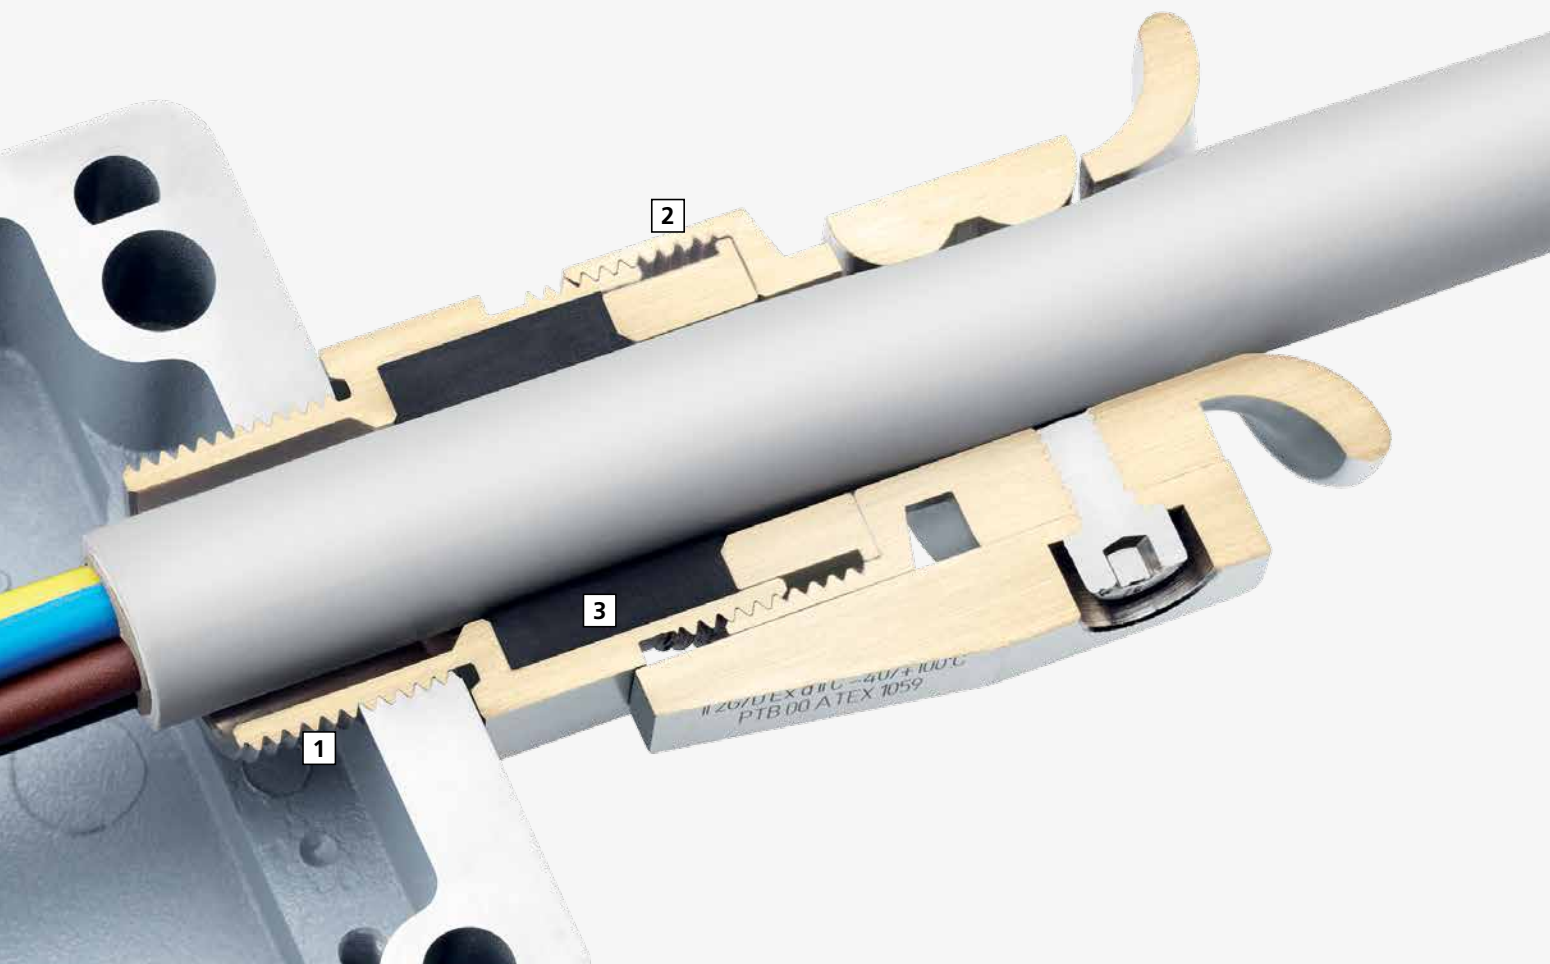

Flameproof enclosures Ex d IIC and increased safety Ex e II

Certification including ageing and climatic tests

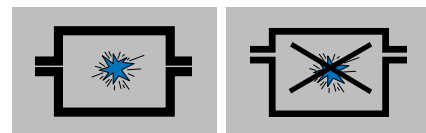

Principle

With ignition protection type Ex d IIC, components which can ignite an explosive atmosphere are arranged in a housing. This housing must contain the pressure of the explosion and an explosive mixture within itself, and it must prevent the explosion from spreading to the explosive atmosphere surrounding the housing.

Important design parameters

- The mechanical stability must correspond to that of a predetermined safety factor against internal explosion pressures.
- Gaps between two parts of a housing must be designed sufficiently long and narrow that exiting hot gas cannot ignite an explosive atmosphere which might be present in the hazardous area.
- The parameters for the gaps preventing an arc-through, width/length, are different for Explosion Subgroups IIA, IIB and IIC. The highest requirements on gap parameters are placed on the housings of Explosion Subgroup IIC.

Applications

- Equipment which during normal operation can generate sparks or electric arcs and/or hot components; this includes switchgear and circuit breakers, controls, motors, transformers, slip rings, collectors, regulating resistors, fuses, lighting fixtures, heating cartridges and friction brakes.

Cable glands for flameproof enclosures are tested according to IEC/EN 60079-1 for the following points:

- mechanical design and pressure testing
- electrical and thermal behaviour

1 Entry threads

Long entry threads in metric, Pg, gas pipe or NPT designs provide maximum safety with respect to the quality of attachment.

2 Spanner surfaces


Large, solid spanner surfaces on the pressure nut and bottom section allow safe tightening with the assembly tool.

3 Guaranteed sealing capability

The ingenious sealing insert and matching inner contours ensure a targeted deformation of the insert and thus guarantee its tightness. Protection Class IP68 (30 bar) facilitate optimal usage.

Testing standards

IEC 60079-0:2011 / EN 60079-0:2009
IEC 60079-1:2007 / EN 60079-1:2007
IEC 60079-31:2008 / EN 60079-31:2009

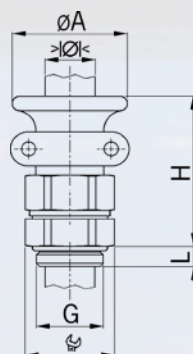

Designation: Series 18
Material: Nickel-plated brass
Screws: Stainless steel A2
Seal: NBR
 one-piece sealing insert, not overall length insulated
O-Ring: FPM
Temperature range: -40°C / +100°C
Protection class: IP 68 (30 bar)
Test standard: see page 8
Category 2G: II 2G Ex db eb IIC
Category 2D: II 2D Ex ta IIIC
Zone: Gas 1 and 2 / dust 21 and 22
Certificate: PTB 00 ATEX 1059
IECEx Certificate: IECEx PTB 12.0056
Approvals:



Entry thread metric

G	>Ø< min mm	>Ø< max mm	mm	ØA mm	H mm	L mm	Art.no.	
M16x1.5	7.0	9.0	20	27	57	12	1817.09.26	25
M20x1.5	9.0	11.0	24	30	57	12	1820.11.26	25
M20x1.5	11.0	13.0	26	32	57	14	1820.16.26	25
M25x1.5	13.0	16.5	32	40	67	16	1825.21.26	10
M25x1.5	16.5	20.0	36	44	67	16	1825.21.27	10
M32x1.5	20.0	24.0	46	48	78	17	1832.29.26	5
M40x1.5	24.0	28.0	46	52	78	17	1840.29.27	5
M50x1.5	28.0	32.0	55	60	85	17	1850.36.26	5
M50x1.5	32.0	36.0	55	64	85	17	1850.36.27	5
M63x1.5	36.0	40.0	70	75	88	20	1863.48.26	1
M63x1.5	40.0	44.0	70	80	88	20	1863.48.27	1

Entry thread Pg


G	>Ø< min mm	>Ø< max mm	mm	ØA mm	H mm	L mm	Art.no.	
Pg 9	7.0	9.0	20	27	57	12	1809.26	25
Pg 11	9.0	11.0	24	30	57	12	1811.26	25
Pg 13	11.0	13.0	26	32	57	14	1813.26	25
Pg 16	11.0	13.0	26	32	57	14	1816.26	25
Pg 21	13.0	16.5	32	40	67	16	1821.26	10
Pg 21	16.5	20.0	36	44	67	16	1821.27	10
Pg 29	20.0	24.0	45	48	78	17	1829.26	5
Pg 29	24.0	28.0	45	52	78	17	1829.27	5
Pg 36	28.0	32.0	55	60	85	17	1836.26	5
Pg 36	32.0	36.0	55	64	85	17	1836.27	5
Pg 48	36.0	40.0	64	75	88	20	1848.48.26	1
Pg 48	40.0	44.0	64	80	88	20	1848.48.27	1

Entry thread NPT

G	>Ø< min mm	>Ø< max mm	mm	ØA mm	H mm	L mm	Art.no.	
NPT 3/8"	7.0	9.0	20	27	57	15.5	183/8NPT.09.26	25
NPT 1/2"	9.0	11.0	24	30	57	20	181/2NPT.11.26	25
NPT 1/2"	11.0	13.0	26	32	57	20	181/2NPT.16.26	25
NPT 3/4"	9.0	11.0	27	30	57	20	183/4NPT.11.26	25
NPT 3/4"	11.0	13.0	26/27	32	57	20	183/4NPT.16.26	25
NPT 3/4"	13.0	16.5	32	40	67	20	183/4NPT.21.26	10
NPT 1"	13.0	16.5	32/34	40	67	25	181NPT.21.26	10
NPT 1"	16.5	20.0	36	44	67	25	181NPT.21.27	10
NPT 1 1/4"	20.0	24.0	45	48	78	26	1811/4NPT.29.26	5
NPT 1 1/4"	24.0	28.0	45	52	78	26	1811/4NPT.29.27	5
NPT 1 1/2"	28.0	32.0	55	60	85	26	1811/2NPT.36.26	5
NPT 1 1/2"	32.0	36.0	55	64	85	26	1811/2NPT.36.27	5


Gas-pipe entry thread

G	>Ø< min mm	>Ø< max mm	mm	ØA mm	H mm	L mm	Art.no.	
G 3/8"	7.0	9.0	20	27	57	12	183/8G.09.26	25
G 1/2"	9.0	11.0	24	30	57	14	181/2G.11.26	25
G 1/2"	11.0	13.0	26	32	57	14	181/2G.16.26	25
G 3/4"	13.0	16.5	32	40	67	16	183/4G.21.26	10
G 3/4"	16.5	20.0	36	44	67	16	183/4G.21.27	10
G 1"	20.0	24.0	45	48	78	17	181G.29.26	5
G 1 1/4"	24.0	28.0	45	52	78	17	1811/4G.29.27	5
G 1 1/2"	28.0	32.0	55	60	85	17	1811/2G.36.26	5
G 2"	36.0	40.0	64	75	88	20	1848.26	1
G 2"	40.0	44.0	64	80	88	20	1848.27	1

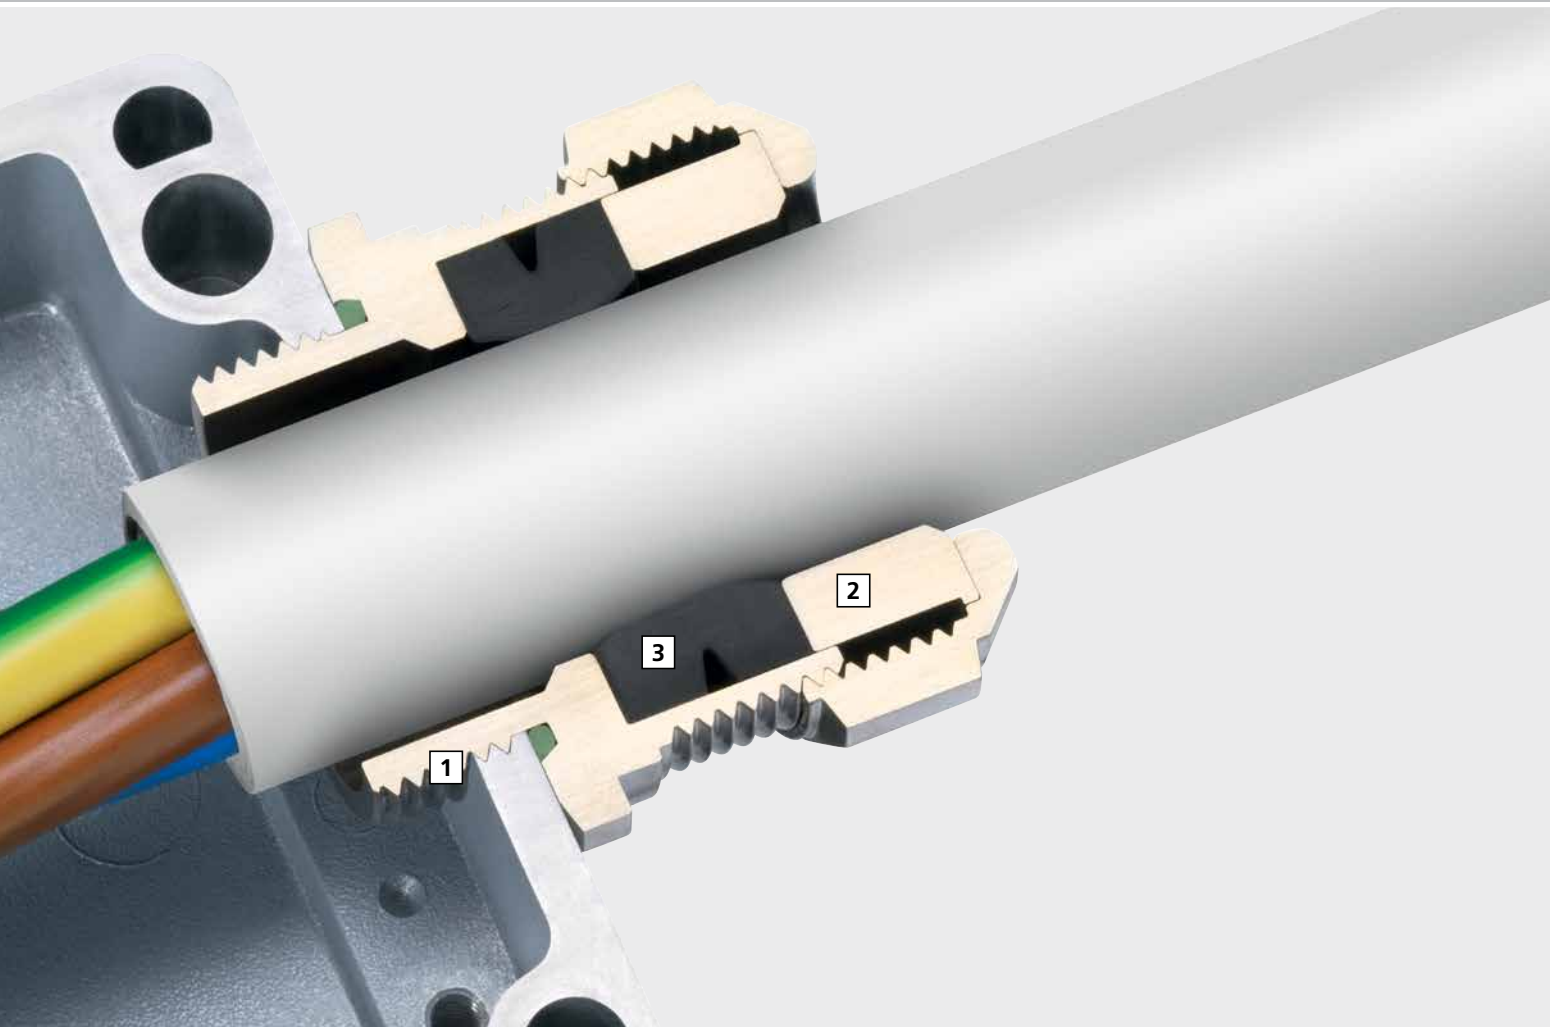

Flameproof enclosures Ex d IIC and increased safety Ex e II

Certification including ageing and climatic tests

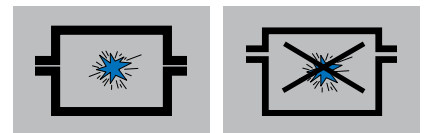

For a description of the protection type of flameproof enclosures, please see Page 8 of this brochure.

Ex e II principle

In the case of ignition protection with an increased safety type, operation is based on the equipment preventing ignition of the explosive atmosphere which can also leak into the housing. The equipment may not reach temperatures which are above the temperature class of gases which could potentially arise in the place of use, and sparks caused by electrical or mechanical means may also not occur. In electrical machines, electrical-thermal testing is thus of particular importance. In operation, protection against overloading is essentially important to maintaining explosion protection.

Important design parameters

- There are special protection requirements for non-insulated active components.
- Air and creepage gaps are dimensioned larger than is generally the case in industry. Special requirements apply to the IP protection classes which must be maintained.
- More stringent requirements apply to windings with mechanical stability and insulating capacity, and the windings must be protected against elevated temperatures.

Applications

- Installation materials such as junction boxes and distribution boxes, terminal compartments for heaters, storage batteries,

transformers, inductive ballasts, electrical motors, squirrel cage induction motors, lighting fixtures.

Cable glands for increased safety are tested according to IEC/EN 60079-7 for the following points:

- mechanical design
- electrical-thermal testing

1 Entry threads

Long entry threads in metric designs allow maximum safety with respect to the quality of attachment.

2 Compact design

The compact design allows space-saving assembly on equipment, and the large clamping range reduces the number of different types.





3 Guaranteed sealing capability

The ingenious sealing insert and matching inner contours ensure a targeted deformation of the insert and thus guarantee its tightness. Protection Class IP68 (30 bar) facilitate optimal usage.



Testing standards

IEC 60079-0:2011 / EN 60079-0:2009
IEC 60079-1:2007 / EN 60079-1:2007
IEC 60079-7:2006 / EN 60079-7:2007
IEC 60079-31:2008 / EN 60079-31:2009




Designation: Ex Compact MS
Material: Nickel-plated brass
Seal: NBR
one-piece sealing insert, not overall length insulated
FPM
O-Ring :
Temperature range: -60°C / +105°C
Protection class: IP 68 (30 bar)
Test standard: see page 10
Category 2G: II 2G Ex db eb IIC
Category 2D: II 2D Ex ta IIIC
Zone: Gas 1 and 2 / dust 21 and 22
Certificate: PTB 10 ATEX 1034X
IECEX Certificate: IECEX PTB 12.0055X
Approvals:    

Entry thread metric

G	>Ø< min mm	>Ø< max mm	 mm	H mm	L mm	Art.no.	
M16x1.5	3.0	7.0	21	26	12	EX1126.17.070	25
M16x1.5	5.0	10.0	24	26	12	EX1126.17.100	25
M20x1.5	5.0	11.0	24	26	12	EX1126.20.110	25
M20x1.5	9.0	14.0	30	26	12	EX1126.20.140	25
M25x1.5	7.5	15.0	32	28	12	EX1126.25.150	20
M25x1.5	12.5	18.0	32	28	12	EX1126.25.180	20
M32x1.5	17.0	23.0	41	33	12	EX1126.32.230	10
M32x1.5	21.0	26.0	41	33	12	EX1126.32.260	10
M40x1.5	21.0	26.0	41	33	14	EX1126.40.260	10
M40x1.5	24.0	32.0	50	34	14	EX1126.40.320	10
M50x1.5	28.0	36.0	55	34	14	EX1126.50.360	5
M50x1.5	35.0	42.0	60	35	14	EX1126.50.420	5
M63x1.5	36.0	44.0	65	35	14	EX1126.63.440	1
M63x1.5	43.0	50.0	70	35	14	EX1126.63.500	1


Available on demand:

- Versions in steel A2 and A4
- Entry thread NPT

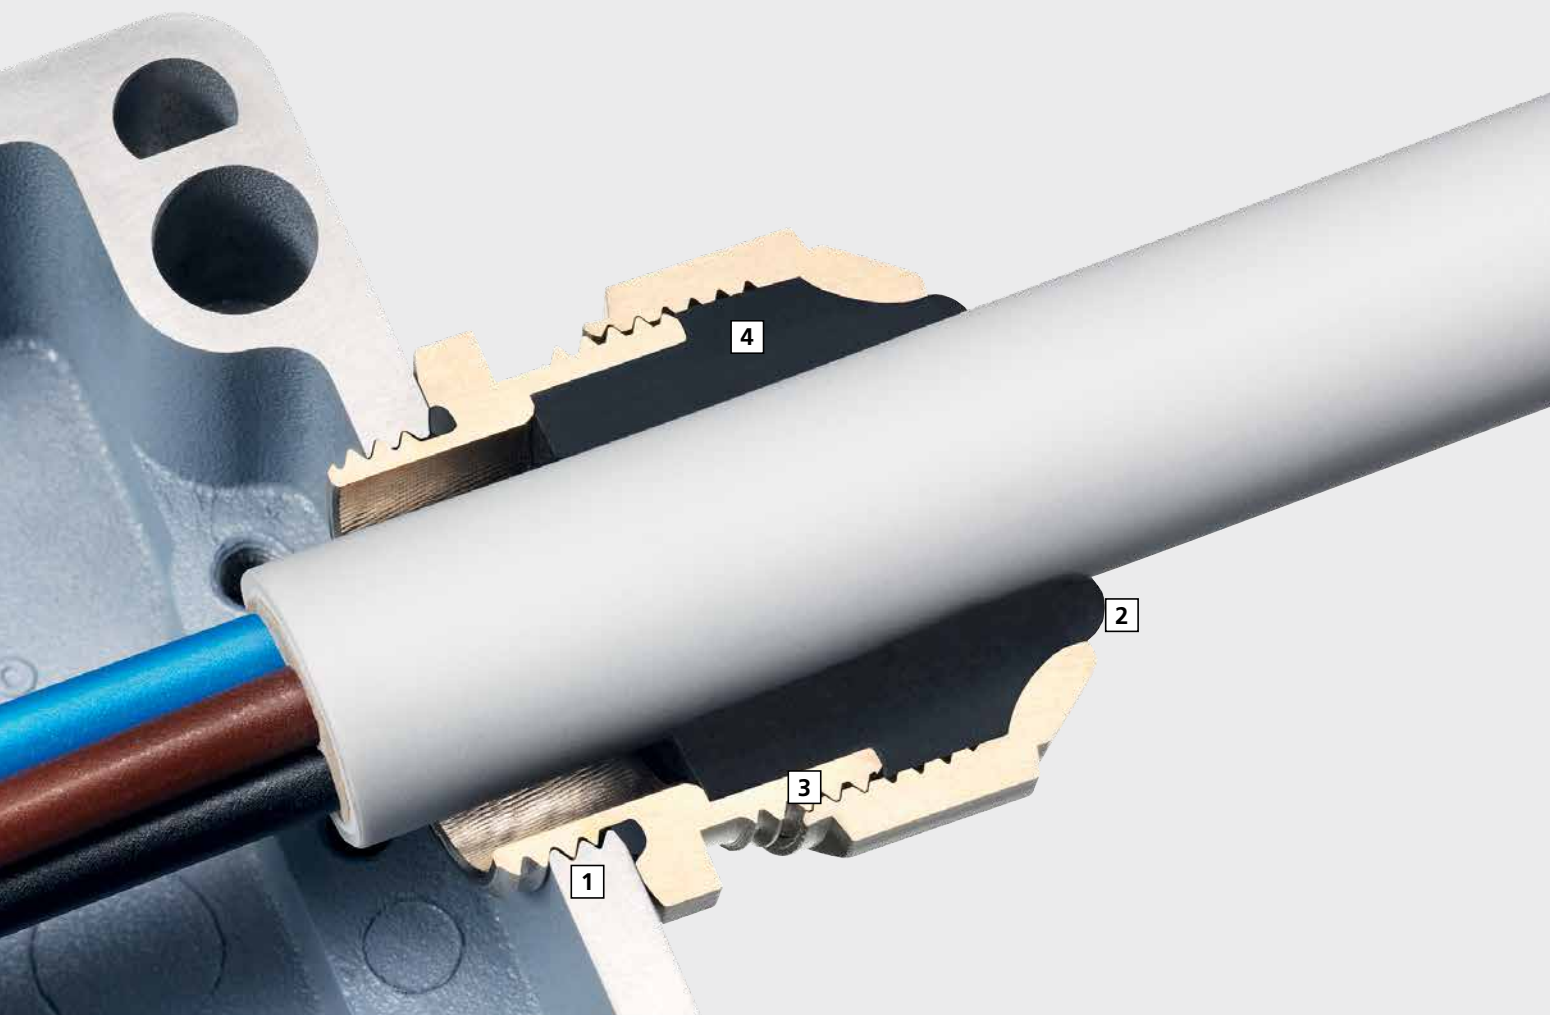

Increased safety Ex e II

Certification including ageing and climatic tests



Principle

In the case of ignition protection with an increased safety type, operation is based on the equipment preventing an ignition of the explosive atmosphere which can also leak into the housing. The equipment may not reach temperatures which are above the temperature class of gases which could potentially arise in the place of use, and sparks caused by electrical or mechanical means may also not occur. In electrical machines, electrical-thermal testing is thus of particular importance. In operation, protection against overloading is essentially important to maintaining explosion protection.

Important design parameters

- Special protection requirements for non-insulated active components.
- Air and creepage gaps are dimensioned larger than is generally the case in industry. Special requirements apply to the IP protection classes which must be maintained.
- More stringent requirements apply to windings with mechanical stability and insulating capacity, and the windings must be protected against elevated temperatures.

Applications

Installation materials such as junction boxes and distribution boxes, terminal compartments for heaters, storage batteries, transformers, inductive ballasts, electrical and squirrel cage induction motors, lighting fixtures.

Cable glands for increased safety are tested according to IEC/EN 60079-7 for the following points:

- mechanical design
- electrical-thermal testing

1 Short, long or special entry threads

Progress® cable glands with short or long entry threads in metric or Pg designs can be used with existing threads or, in the case of drilled through holes, with locknuts.

2 Visible safety

The small bead on the sealing insert confirms the proper tightening torque.

3 High distortion protection

The integrated retaining grooves in the lower part and in the sealing insert ensure protection against twisting.

4 Guaranteed sealing capability


Inner contours matched to the sealing insert ensure a targeted deformation of the insert and thus guarantee its tightness. Protection Class IP68 to 10 bar as well as IP69K allow a wide range of uses.





Certified according to



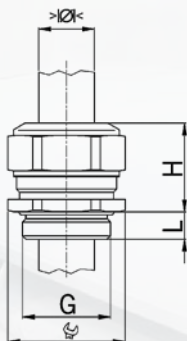

EN 60079-0:2012 + A11:2013 and IEC 60079-0:2011 (Ed. 6)

EN 60079-7:2015 and IEC 60079-7:2015 (Ed. 5)

EN 60079-31:2014 and IEC 60079-31:2013 (Ed. 2)




Designation: Progress MS EX
Material: Nickel-plated brass
Seal: TPE
 one-piece sealing insert, not overall length insulated
O-Ring: FPM
Temperature range: -60°C / +100°C
Protection class: IP 66 / IP 68 (up to 10 bar)
Test standard: see page 12
Category 2G: II 2G Ex eb IIC Gb
Category 2D: II 2D Ex tb IIIC Db
Zone: Gas 1 and 2 / dust 21 and 22
Certificate: SEV 15 ATEX 0152X
IECEx Certificate: IECEx SEV 15.0019X
Approvals:    





Short entry thread metric										Short entry thread Pg									
G	>Ø< min mm	>Ø< max mm	 mm	H mm	L mm	i info	Art.no.			G	>Ø< min mm	>Ø< max mm	 mm	H mm	L mm	Art.no.			
M8x1.25	3.0	3.5	11	14	5	1	EX1000.08.035	50		Pg 7	5.0	6.5	15	17	6	EX1000.07.065	50		
M8x1.25	4.0	5.0	11	14	5	1	EX1000.08.050	50		Pg 7	6.5	8.0	15	17	6	EX1000.07.080	50		
M10x1.5	3.0	4.0	13	15	5	1	EX1000.10.040	50		Pg 9	4.5	6.0	18	20	6	EX1000.09.060	50		
M10x1.5	4.5	6.0	13	15	5	1	EX1000.10.060	50		Pg 9	6.0	8.0	18	20	6	EX1000.09.080	50		
M12x1.5	5.0	6.5	15	17	5	-	EX1000.12.065	50		Pg 11	4.0	5.5	21	21	6	EX1000.11.055	50		
M12x1.5	6.5	8.0	15	17	5	-	EX1000.12.080	50		Pg 11	5.5	8.5	21	21	6	EX1000.11.085	50		
M16x1.5	4.5	6.0	18	20	5	-	EX1000.17.060	50		Pg 13	6.0	8.0	24	21	6	EX1000.13.080	50		
M16x1.5	6.0	8.0	18	20	5	-	EX1000.17.080	50		Pg 13	8.0	11.0	24	21	6	EX1000.13.110	50		
M20x1.5	6.0	8.0	24	21	6	-	EX1000.20.080	50		Pg 16	6.0	8.0	24	21	6	EX1000.16.080	50		
M20x1.5	8.0	11.0	24	21	6	-	EX1000.20.110	50		Pg 16	8.0	11.0	24	21	6	EX1000.16.110	50		
M25x1.5	9.5	12.5	30	25	7	-	EX1000.25.125	25		Pg 21	9.5	12.5	30	25	7.5	EX1000.21.125	25		
M25x1.5	12.5	16.0	30	27	7	-	EX1000.25.160	25		Pg 21	12.5	16.0	30	25	7.5	EX1000.21.160	25		
M32x1.5	14.0	17.0	36	28	8	-	EX1000.32.170	25		Pg 29	16.0	19.0	38	28	8	EX1000.29.190	25		
M32x1.5	17.0	21.0	36	28	8	-	EX1000.32.210	25		Pg 29	19.0	23.0	38	28	8	EX1000.29.230	25		
M40x1.5	20.0	24.0	46	31	8	-	EX1000.40.240	10		Pg 36	21.5	26.0	50	32	8	EX1000.36.260	10		
M40x1.5	24.0	28.5	46	31	8	-	EX1000.40.285	10		Pg 36	26.0	30.5	50	32	8	EX1000.36.305	10		



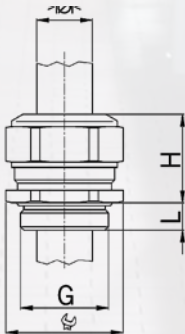

1 = Metric coarse-pitch thread

Available on demand:

- Versions in steel A2 and A4
- Entry thread NPT








Designation: Progress MS EX
Material: nickel-plated brass
Seal: TPE
one-piece sealing insert, not overall length insulated
O-Ring: FPM
Temperature range: -60°C / +100°C
Protection class: IP 66 / IP 68 (up to 10 bar)
Test standard: see page 12
Category 2G: II 2G Ex eb IIC Gb
Category 2D: II 2D Ex tb IIIC Db
Zone: Gas 1 and 2 / dust 21 and 22
Certificate: SEV 15 ATEX 0152X
IECEx Certificate: IECEx SEV 15.0019X
Approvals:    

Long entry thread metric									Long entry thread Pg								
G	>Ø< min mm	>Ø< max mm	 mm	H mm	L mm	i info	Art.no.		G	>Ø< min mm	>Ø< max mm	 mm	H mm	L mm	Art.no.		
M8x1.25	3.0	3.5	11	14	10	1	EX1100.08.035	50	Pg 7	5.0	6.5	15	17	10	EX1100.07.065	50	
M8x1.25	4.0	5.0	11	14	10	1	EX1100.08.050	50	Pg 7	6.5	8.0	15	17	10	EX1100.07.080	50	
M10x1.5	3.0	4.0	13	15	10	1	EX1100.10.040	50	Pg 9	4.5	6.0	18	20	10	EX1100.09.060	50	
M10x1.5	4.5	6.0	13	15	10	1	EX1100.10.060	50	Pg 9	6.0	8.0	18	20	10	EX1100.09.080	50	
M12x1.5	5.0	6.5	15	17	10	-	EX1100.12.065	50	Pg 11	4.0	5.5	21	21	10	EX1100.11.055	50	
M12x1.5	6.5	8.0	15	17	10	-	EX1100.12.080	50	Pg 11	5.5	8.5	21	21	10	EX1100.11.085	50	
M16x1.5	4.5	6.0	18	20	10	-	EX1100.17.060	50	Pg 13	6.0	8.0	24	21	10	EX1100.13.080	50	
M16x1.5	6.0	8.0	18	20	10	-	EX1100.17.080	50	Pg 13	8.0	11.0	24	21	10	EX1100.13.110	50	
M20x1.5	6.0	8.0	24	21	10	-	EX1100.20.080	50	Pg 16	6.0	8.0	24	21	10	EX1100.16.080	50	
M20x1.5	8.0	11.0	24	21	10	-	EX1100.20.110	50	Pg 16	8.0	11.0	24	21	10	EX1100.16.110	50	
M25x1.5	9.5	12.5	30	25	11	-	EX1100.25.125	25	Pg 21	9.5	12.5	30	25	12	EX1100.21.125	25	
M25x1.5	12.5	16.0	30	27	11	-	EX1100.25.160	25	Pg 21	12.5	16.0	30	25	12	EX1100.21.160	25	
M32x1.5	14.0	17.0	36	28	13	-	EX1100.32.170	25	Pg 29	16.0	19.0	38	28	12	EX1100.29.190	25	
M32x1.5	17.0	21.0	36	28	13	-	EX1100.32.210	25	Pg 29	19.0	23.0	38	28	12	EX1100.29.230	25	
M40x1.5	20.0	24.0	46	31	13	-	EX1100.40.240	10	Pg 36	21.5	26.0	50	32	15	EX1100.36.260	10	
M40x1.5	24.0	28.5	46	31	13	-	EX1100.40.285	10	Pg 36	26.0	30.5	50	32	15	EX1100.36.305	10	

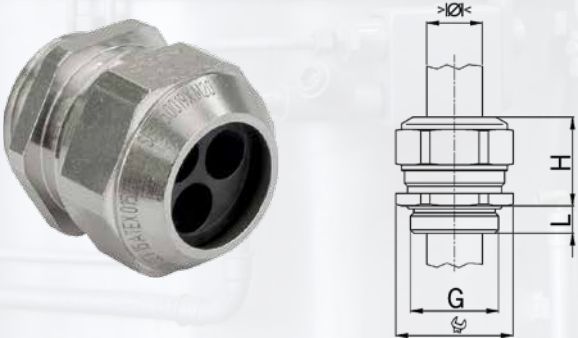


1 = Metric coarse-pitch thread

Available on demand:
- Versions in steel A2 and A4
- Entry thread NPT






Designation: Progress MS Multi EX
Material: Nickel-plated brass
Seal: TPE / NBR
one-piece sealing insert, not overall length insulated
O-Ring: FPM
Temperature range: -60°C / +100°C
Protection class: IP 68 / IIP 68
Test standard: see page 12
Category 2G: II 2G Ex eb IIC Gb
Category 2D: II 2D Ex tb IIIC Db
Zone: Gas 1 and 2 / dust 21 and 22
Certificate: SEV 15 ATEX 0152X
IECEx Certificate: IECEx SEV 15.0019X
Approvals:    

Short entry thread metric

G	>Ø< min mm	>Ø< max mm			H mm	L mm	i info	Art.no.	
M12x1.5	0.6	1.0	3	15	17	5	3	EX1310.12.3.010	50
M16x1.5	1.0	1.5	4	18	20	5	3	EX1310.17.4.015	50
M16x1.5	2.0	3.0	2	18	20	5	-	EX1310.17.2.030	50
M20x1.5	2.5	3.0	6	24	21	6	-	EX1310.20.6.030	50
M20x1.5	3.5	5.0	2	24	21	6	-	EX1310.20.2.050	50
M20x1.5	3.5	5.0	4	24	21	6	-	EX1310.20.4.050	50
M20x1.5	4.5	6.0	3	24	21	6	-	EX1310.20.3.060	50
M20x1.5	5.5	7.5	2	24	21	6	-	EX1310.20.2.075	50
M25x1.5	5.0	6.0	6	30	25	7	-	EX1310.25.6.060	25
M25x1.5	6.0	7.0	3	30	25	7	-	EX1310.25.3.070	25
M25x1.5	5.5	7.0	4	30	25	7	-	EX1310.25.4.070	25
M25x1.5	7.5	9.0	3	30	25	7	-	EX1310.25.3.090	25
M25x1.5	8.0	10.0	2	30	25	7	-	EX1310.25.2.100	25
M32x1.5	6.0	7.0	6	36	28	8	-	EX1310.32.6.070	25
M32x1.5	7.5	9.0	4	36	28	8	-	EX1310.32.4.090	25
M40x1.5	8.0	9.0	7	46	31	8	3	EX1310.40.7.090	10
M40x1.5	14.0	15.0	2	46	31	8	3	EX1310.40.2.150	10
M50x1.5	9.0	10.0	4	55	34	9	3	EX1310.50.4.100	10
M63x1.5	11.0	12.0	6	70	37	10	3	EX1310.63.6.120	5
M63x1.5	17.0	18.0	3	70	37	10	3	EX1310.63.3.180	5

3 = Material sealing insert NBR


Short entry thread Pg





G	>Ø< min mm	>Ø< max mm			H mm	L mm	i info	Art.no.	
Pg 9	1.0	1.5	4	18	20	6	3	EX1310.09.4.015	50
Pg 9	2.0	3.0	2	18	20	6	-	EX1310.09.2.030	50
Pg 11	2.0	3.0	3	21	21	6	3	EX1310.11.3.030	50
Pg 11	3.0	4.0	2	21	21	6	3	EX1310.11.2.040	50
Pg 11	3.5	5.0	2	21	21	6	-	EX1310.11.2.050	50
Pg 13	2.5	4.0	3	24	23	6	3	EX1310.13.3.040	50
Pg 13	3.5	5.0	2	24	23	6	-	EX1310.13.2.050	50
Pg 16	2.5	3.0	6	24	23	6	-	EX1310.16.6.030	50
Pg 16	3.0	4.0	6	24	23	6	3	EX1310.16.6.040	50
Pg 16	4.5	6.0	2	24	23	6	-	EX1310.16.2.060	50
Pg 16	4.5	6.0	3	24	23	6	-	EX1310.16.3.060	50
Pg 21	5.5	7.0	4	30	28	7	-	EX1310.21.4.070	25
Pg 21	7.5	9.0	3	30	28	7	-	EX1310.21.3.090	25
Pg 29	5.5	6.5	6	38	28	8	3	EX1310.29.6.065	25
Pg 29	8.0	9.0	3	38	28	8	3	EX1310.29.3.090	25
Pg 36	9.0	10.0	4	50	32	8	3	EX1310.36.4.100	10
Pg 36	14.0	15.0	2	50	32	8	3	EX1310.36.2.150	10
Pg 48	11.0	12.0	6	65	37	11	3	EX1310.48.6.120	5
Pg 48	17.0	18.0	3	65	37	11	3	EX1310.48.3.180	5

3 = Material sealing insert NBR

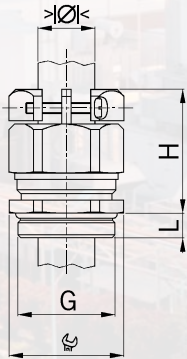

Available on demand:

- Versions in steel A2 and A4
- Entry thread NPT



Designation: Progress MS KB EX
Material: Nickel-plated brass
Screws: Stainless steel A2
Seal: TPE
O-Ring: FPM
Temperature range: -60°C / +100°C
Protection class: IP 66 / IP 68 (up to 10 bar)
Test standard: see page 12
Category 2G: II 2G Ex eb IIC Gb
Category 2D: II 2D Ex tb IIIC Db
Zone: Gas 1 and 2 / dust 21 and 22
Certificate: SEV 15 ATEX 0151
IECEx Certificate: IECEx SEV 15.0018
Approvals:    



One-piece sealing insert, not overall insulating
Short entry thread metric

G	>Ø< min mm	>Ø< max mm	 mm	H mm	L mm	Art.no.	
M12x1.5	5.0	6.5	15/16	26	5	EX1803.12.03.065	50
M12x1.5	6.5	8.0	15/16	26	5	EX1803.12.03.080	50



One-piece sealing insert, not overall insulating
Short entry thread Pg

G	>Ø< min mm	>Ø< max mm	 mm	H mm	L mm	Art.no.	
Pg 7	5.0	6.5	15/16	26	6	EX1803.07.03.065	50
Pg 7	6.5	8.0	15/16	26	6	EX1803.07.03.080	50

Two-piece sealing insert, not overall insulating
Short entry thread metric


G	>Ø< min mm	>Ø< max mm	 mm	H mm	L mm	Art.no.	
M16x1.5	6.0	10.5	18/19	30	5	EX1803.17	50
M20x1.5	8.0	15.0	24	31	6	EX1803.20	50
M25x1.5	12.5	20.5	30	35	7	EX1803.25	25
M32x1.5	17.0	25.5	36	40	8	EX1803.32	25
M40x1.5	24.0	33.0	46	44	8	EX1803.40	10
M50x1.5	33.0	42.0	55	49	9	EX1803.50	10
M63x1.5	40.0	52.0	70	55	10	EX1803.63	5




Two-piece sealing insert, not overall insulating
Short entry thread Pg

G	>Ø< min mm	>Ø< max mm	 mm	H mm	L mm	Art.no.	
Pg 9	6.0	10.5	18/19	30	6	EX1803.09	50
Pg 11	5.5	12.0	21	31	6	EX1803.11	50
Pg 13	8.0	15.0	24	31	6	EX1803.13	50
Pg 16	8.0	15.0	24	31	6	EX1803.16	50
Pg 21	12.5	20.5	30	35	7.5	EX1803.21	25
Pg 29	19.0	27.5	38	40	8	EX1803.29	25
Pg 36	26.0	35.0	50	47	8	EX1803.36	10
Pg 42	33.0	42.0	55	49	10	EX1803.42	10
Pg 48	37.0	49.0	65	51	11	EX1803.48	5



Available on request:

- Cable glands nickel-plated brass with long entry thread
- Cable glands stainless steel Stahl A2 or acid proof stainless steel A4




Designation: Pressure balance element
Material: Nickel-plated brass
Membrane: PES (Polyethersulfone)
Temperature range: -60°C / +100°C
Protection class: IP 66 / IP 68
Test standard: see page 12
Category 2G: II 2G Ex eb IIC Gb
Category 2D: II 2D Ex tb IIIC Db
Zone: Gas 1 and 2 / Dust 21 and 22
Certificate: SEV 16 ATEX 0143
IECEx Certificate: IECEx SEV 16.0010
Approvals:   





Pressure balance element with membrane

G		H mm	L mm	Art.no.	
M12x1.5	18	9.5	8	EX2450.12.34	25
M16x1.5	18	9.5	8	EX2450.17.34	20
M20x1.5	22	10.0	8	EX2450.20.34	20

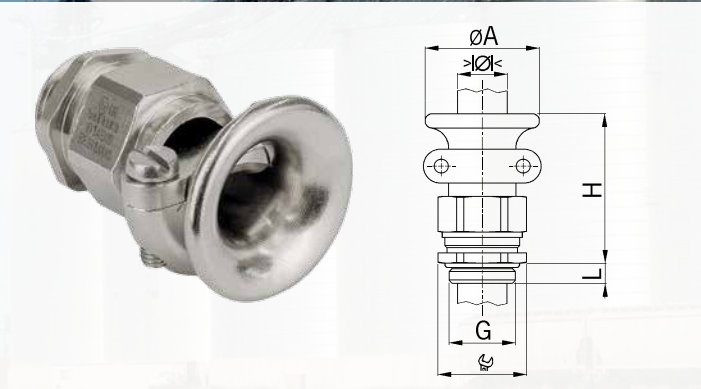

Available from December 2016 onwards.

Available on demand:
- Versions in steel A2 and A4
- Entry thread Pg





Designation: Progress MS T+KB EX
Material: Nickel-plated brass
Screws: Stainless steel A2
Seal: TPE
two-piece, not overall insulating
O-Ring: FPM
Temperature range: -60°C / +100°C
Protection class: IP 66 / IP 68 (up to 10 bar)
Test standard: see page 12
Category 2G: II 2G Ex eb IIC Gb
Category 2D: II 2D Ex tb IIIC Db
Zone: Gas 1 and 2 / Dust 21 and 22
Certificate: SEV 15 ATEX 0151
IECEx Certificate: IECEx SEV 15.0018
Approvals:    



Short entry thread metric

G	>Ø< min mm	>Ø< max mm	 mm	ØA mm	H mm	L mm	Art.no.	
M16x1.5	6.0	10.5	18	28	43	5	EX1801.17	50
M20x1.5	8.0	15.0	24	34	46	6	EX1801.20	50
M25x1.5	12.5	20.5	30	44	52	7	EX1801.25	25
M32x1.5	17.0	25.5	36	50	59	8	EX1801.32	10
M40x1.5	24.0	33.0	46	57	59	8	EX1801.40	5



Short entry thread Pg

G	>Ø< min mm	>Ø< max mm	 mm	ØA mm	H mm	L mm	Art.no.	
Pg 9	6.0	10.5	18	28	43	6	EX1801.09	50
Pg 11	5.5	12.0	21	30	43	6	EX1801.11	50
Pg 13	8.0	15.0	24	34	46	6	EX1801.13	50
Pg 16	8.0	15.0	24	34	46	6	EX1801.16	50
Pg 21	12.5	20.5	30	44	52	7.5	EX1801.21	25
Pg 29	19.0	27.5	38	50	59	8	EX1801.29	10

Long entry thread metric


G	>Ø< min mm	>Ø< max mm	 mm	ØA mm	H mm	L mm	Art.no.	
M16x1.5	6.0	10.5	18	28	43	10	EX1811.17	50
M20x1.5	8.0	15.0	24	34	46	10	EX1811.20	50
M25x1.5	12.5	20.5	30	44	52	11	EX1811.25	25
M32x1.5	17.0	25.5	36	50	59	13	EX1811.32	10
M40x1.5	24.0	33.0	46	57	59	13	EX1811.40	5

Long entry thread Pg





G	>Ø< min mm	>Ø< max mm	 mm	ØA mm	H mm	L mm	Art.no.	
Pg 9	6.0	10.5	18	28	43	10	EX1811.09	50
Pg 11	5.5	12.0	21	30	43	10	EX1811.11	50
Pg 13	8.0	15.0	24	34	46	10	EX1811.13	50
Pg 16	8.0	15.0	24	34	46	10	EX1811.16	50
Pg 21	12.5	20.5	30	44	52	12	EX1811.21	25
Pg 29	19.0	27.5	38	50	59	12	EX1811.29	10

Available on request:

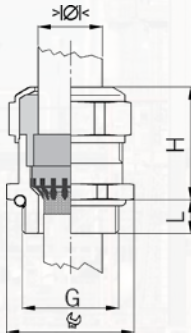- Cable glands nickel-plated brass with trumpet and clamps and FPM sealing insert for high temperature applications (+200°C)



Designation: Progress MS EMV Rapid EX
Material: Nickel-plated brass
Seal: TPE
O-Ring : FPM
one-piece sealing insert, not overall length insulated
Temperature range: -60°C / +100°C
Protection class: IP 66 / IP 68 (up to 10 bar)
Test standard: see page 12
Category 2G: II 2G Ex eb IIC Gb
Category 2D: II 2D Ex tb IIIC Db
Zone: Gas 1 and 2 / dust 21 and 22
Certificate: SEV 15 ATEX 0152X
IECEx Certificate: IECEx SEV 15.0019X
Caracteristics: For a quick installation of partially dismantled cables as well as for thoroughly shielded cables

Approvals:    


Short entry thread metric


G	>Ø< min mm	>Ø< max mm	RC mm	H mm	L mm	Art.no.	
M12x1.5	4.5	6.0	15	20	5	EX1081.12.060	50
M12x1.5	6.0	7.5	15	20	5	EX1081.12.075	50
M16x1.5	6.0	8.0	18	23	5	EX1081.17.080	50
M16x1.5	8.0	10.0	18	25	5	EX1081.17.100	50
M20x1.5	8.0	11.0	24	25	6	EX1081.20.110	50
M20x1.5	11.0	14.0	24	27	6	EX1081.20.140	50
M25x1.5	13.0	16.0	30	30	7	EX1081.25.160	25
M25x1.5	16.0	19.0	30	33	7	EX1081.25.190	25
M32x1.5	18.0	21.0	36	32	8	EX1081.32.210	25

Available on request:

Long entry thread

Short entry thread Pg

G	>Ø< min mm	>Ø< max mm	RC mm	H mm	L mm	Art.no.	
Pg 7	4.5	6.0	15	20	6	EX1081.07.060	50
Pg 7	6.0	7.5	15	20	6	EX1081.07.075	50
Pg 9	6.0	8.0	18	23	6	EX1081.09.080	50
Pg 9	8.0	10.0	18	25	6	EX1081.09.100	50
Pg 11	5.5	8.5	21	25	6	EX1081.11.085	50
Pg 11	8.5	12.0	21	25	6	EX1081.11.120	50
Pg 13	8.0	11.0	24	25	6	EX1081.13.110	50
Pg 13	12.5	14.0	24	27	6	EX1081.13.140	50
Pg 16	8.0	11.0	24	24	6	EX1081.16.110	50
Pg 16	12.5	14.0	24	27	6	EX1081.16.140	50
Pg 21	13.0	16.0	30	30	7	EX1081.21.160	25
Pg 21	17.0	19.0	30	33	7	EX1081.21.190	25
Pg 29	19.0	23.0	38	33	8	EX1081.29.230	25
Pg 29	23.0	25.5	38	32	8	EX1081.29.255	25

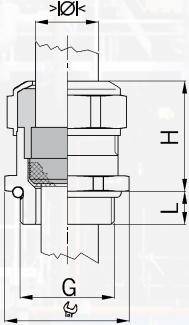

- Designation:

Material:

Seal:

O-Ring :

Temperature range:

Protection class:

Test standard:

Category 2G:

Category 2D:

Zone:

Certificate:

IECEX Certificate:

Properties:

Approvals:
- Progress MS EMV EX

Nickel-plated brass

TPE

one-piece, not overall length insulated

FPM

-60°C / +100°C

IP 66 / IP 68 (up to 10 bar)

see page 12

II 2G Ex eb IIC Gb

II 2D Ex tb IIIC Db

Gas 1 and 2 / Dust 21 and 22

SEV 15 ATEX 0152X

IECEX SEV 15.0019X

Excellent shield contact through the contact sleeve with the braided shield terminating within the cable gland



CE

IECEX

Ex



ATEX

Short entry thread metric


G	>Ø< min mm	>Ø< max mm	 mm	H mm	L mm	i info	Art.no.	
M8x1.25	2.5	3.5	11	15	5	1	EX1080.08.035	50
M8x1.25	3.0	4.0	11	15	5	1	EX1080.08.040	50
M10x1.5	3.0	4.0	13	16	5	1	EX1080.10.040	50
M10x1.5	4.0	6.0	13	16	5	1	EX1080.10.060	50
M12x1.5	4.5	6.0	15	20	5	-	EX1080.12.060	50
M12x1.5	6.0	7.5	15	20	5	-	EX1080.12.075	50
M16x1.5	6.0	8.0	18	23	5	-	EX1080.17.080	50
M16x1.5	8.0	10.0	18	25	5	-	EX1080.17.100	50
M20x1.5	8.0	11.0	24	25	6	-	EX1080.20.110	50
M20x1.5	12.5	14.0	24	27	6	-	EX1080.20.140	50
M25x1.5	13.0	16.0	30	30	7	-	EX1080.25.160	25
M25x1.5	17.0	19.0	30	33	7	-	EX1080.25.190	25
M32x1.5	17.0	21.0	36	32	8	-	EX1080.32.210	25
M40x1.5	23.0	28.5	46	34	8	-	EX1080.40.285	10





1 = Metric coarse-pitch thread

Short entry thread Pg

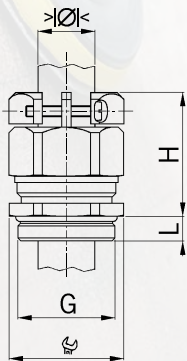

G	>Ø< min mm	>Ø< max mm	 mm	H mm	L mm	Art.no.	
Pg 7	4.5	6.0	15	20	6	EX1080.07.060	50
Pg 7	6.0	7.5	15	20	6	EX1080.07.075	50
Pg 9	6.0	8.0	18	23	6	EX1080.09.080	50
Pg 9	8.0	10.0	18	25	6	EX1080.09.100	50
Pg 11	5.5	8.5	21	23	6	EX1080.11.085	50
Pg 11	9.5	12.0	21	23	6	EX1080.11.120	50
Pg 13	8.0	11.0	24	25	6	EX1080.13.110	50
Pg 13	12.5	14.0	24	27	6	EX1080.13.140	50
Pg 16	8.0	11.0	24	24	6	EX1080.16.110	50
Pg 16	12.5	14.0	24	27	6	EX1080.16.140	50
Pg 21	13.0	16.0	30	30	7.5	EX1080.21.160	25
Pg 21	17.0	19.0	30	33	7.5	EX1080.21.190	25
Pg 29	19.0	23.0	38	33	8	EX1080.29.230	25
Pg 29	24.0	25.5	38	32	8	EX1080.29.255	25
Pg 36	25.0	30.5	50	36	8	EX1080.36.305	10

Available on request:
Long entry thread





Designation: Progress MS EMV KB EX
Material: Nickel-plated brass
Screws: Stainless steel A2
Seal: TPE
one-piece sealing insert, not overall length insulated
O-ring: FPM
Temperature range: -60°C / +100°C
Protection class: IP 66 / IP 68 (up to 10 bar)
Test standard: see page 12
Category 2G: II 2G Ex eb IIC Gb
Category 2D: II 2D Ex tb IIIC Db
Zone: Gas 1 and 2 / Dust 21 and 22
Certificate: SEV 15 ATEX 0151
IECEx Certificate: IECEx SEV 15.0018
Approvals:    


Short entry thread metric

G	>Ø< min mm	>Ø< max mm	 mm	H mm	L mm	Art.no.	
M12x1.5	4.5	6.0	15/16	26	5	EX1803.80.12.060	50
M12x1.5	6.0	7.5	15/16	26	5	EX1803.80.12.075	50
M16x1.5	6.0	8.0	18/19	30	5	EX1803.80.17.080	50
M16x1.5	8.0	10.0	18/19	30	5	EX1803.80.17.100	50
M20x1.5	8.0	11.0	24	31	6	EX1803.80.20.110	50
M20x1.5	11.0	14.0	24	31	6	EX1803.80.20.140	50
M25x1.5	13.0	16.0	30	35	7	EX1803.80.25.160	25
M25x1.5	16.0	19.0	30	35	7	EX1803.80.25.190	25
M32x1.5	18.0	21.0	36	40	8	EX1803.80.32.210	25
M32x1.5	21.0	25.0	36	40	8	EX1803.80.32.250	25
M40x1.5	24.0	28.5	46	44	8	EX1803.80.40.285	10
M40x1.5	28.5	32.0	46	44	8	EX1803.80.40.320	10
M50x1.5	33.0	37.0	55	49	9	EX1803.80.50.370	10
M50x1.5	37.0	41.0	55	49	9	EX1803.80.50.410	10
M63x1.5	40.0	46.0	70	55	10	EX1803.80.63.460	5
M63x1.5	46.0	50.0	70	55	10	EX1803.80.63.500	5

Short entry thread Pg


G	>Ø< min mm	>Ø< max mm	 mm	H mm	L mm	Art.no.	
Pg 7	4.5	6.0	15/16	26	6	EX1803.80.07.060	50
Pg 7	6.0	7.5	15/16	26	6	EX1803.80.07.075	50
Pg 9	6.0	8.0	18/19	30	6	EX1803.80.09.080	50
Pg 9	8.0	10.0	18/19	30	6	EX1803.80.09.100	50
Pg 11	5.5	8.5	21	31	6	EX1803.80.11.085	50
Pg 11	8.5	12.0	21	31	6	EX1803.80.11.120	50
Pg 13	8.0	11.0	24	31	6	EX1803.80.13.110	50
Pg 13	11.0	14.0	24	31	6	EX1803.80.13.140	50
Pg 16	8.0	11.0	24	31	6	EX1803.80.16.110	50
Pg 16	11.0	14.0	24	31	6	EX1803.80.16.140	50
Pg 21	13.0	16.0	30	35	7.5	EX1803.80.21.160	25
Pg 21	16.0	19.0	30	35	7.5	EX1803.80.21.190	25
Pg 29	19.0	23.0	38	40	8	EX1803.80.29.230	25
Pg 29	23.0	25.5	38	40	8	EX1803.80.29.255	25
Pg 36	25.0	30.5	50	47	8	EX1803.80.36.305	10
Pg 36	30.5	35.0	50	47	8	EX1803.80.36.350	10
Pg 42	33.0	37.0	55	49	10	EX1803.80.42.370	10
Pg 42	37.0	41.0	55	49	10	EX1803.80.42.410	10
Pg 48	39.0	43.0	65	51	11	EX1803.80.48.430	5
Pg 48	43.0	46.5	65	51	11	EX1803.80.48.465	5

Available on request:
Long entry thread

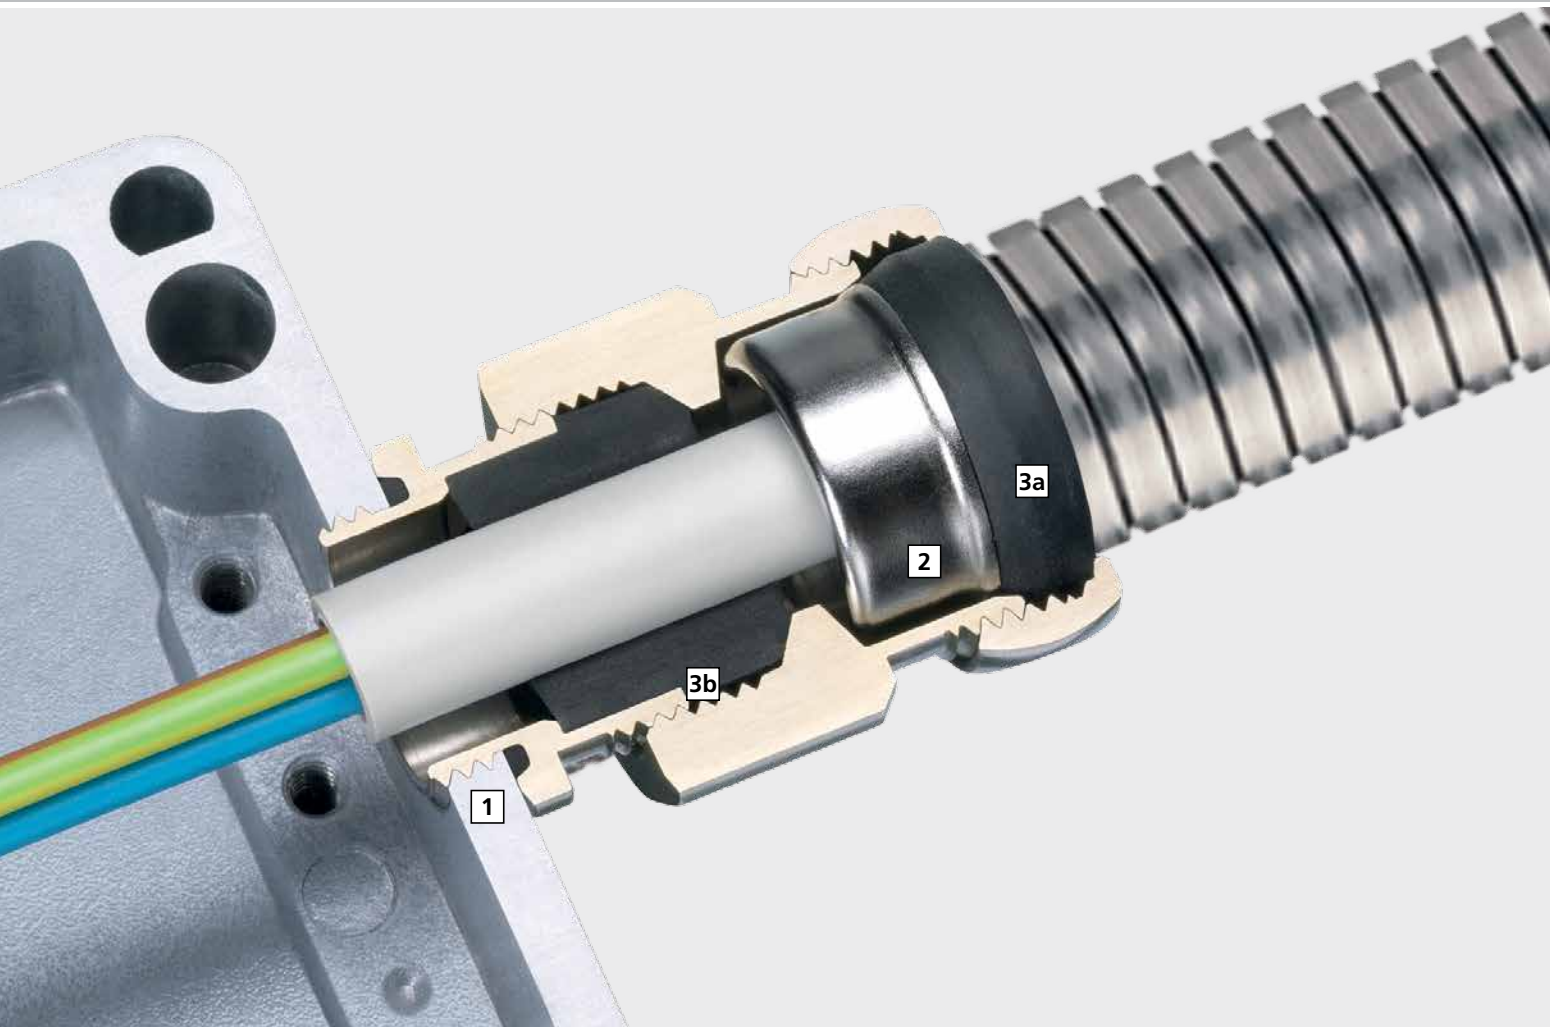

Increased safety Ex e II

Certification including ageing and climatic tests



Principle

In the case of ignition protection with an increased safety type, operation is based on the equipment preventing an ignition of the explosive atmosphere which can also leak into the housing. The equipment may not reach temperatures which are above the temperature class of gases which could potentially arise in the place of use, and sparks caused by electrical or mechanical means may also not occur. In electrical machines, electrical-thermal testing is thus of particular importance. In operation, protection against overloading is essentially important to maintaining explosion protection.

AGRO combination conduit glands provide an optimal mix if you want to feed cables inside a conduit into an enclosure and at the same time want a secure seal and strain relief for the cables.

Attention!

Only metallic or metal-braided conduits may be applied!

Important design parameters

- There are special protection requirements for non-insulated active components.
- Air and creepage gaps are dimensioned larger than is generally the case in industry. Special requirements apply to the IP protection classes which must be maintained.
- More stringent requirements apply to windings with mechanical stability and insulating capacity, and the windings must be protected against elevated temperatures.

Applications

For installations where cable protection is important such as metal-working machines or where mechanical damage can occur or effects due to weather must be excluded.

Conduit glands for increased safety are tested according to IEC/EN 60079-7 for the following points:

- mechanical design
- electrical-thermal testing

1 Short entry threads, metric

Progress® cable glands with short entry threads can be used with existing screw threads.

2 Grounding

The screened tap connection is accomplished with a brass contact sleeve instead of the gasket (3a) over 360°.


3 Guaranteed sealing capability


The sealing capability of the combination conduit gland is ensured not only between the conduit and the conduit gland (3a) but also through the sealing insert in the cable gland (3b) at the entrance into the housing.

Certified according to

EN 60079-0:2012 + A11:2013 and IEC 60079-0:2011 (Ed. 6)
EN 60079-7:2015 and IEC 60079-7:2015 (Ed. 5)
EN 60079-31:2014 and IEC 60079-31:2013 (Ed. 2)





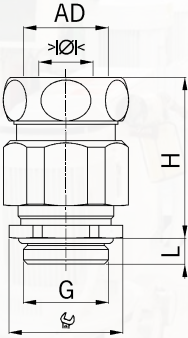

Designation: Progress MS Kombi EX

Material: Nickel-plated brass

Seal: TPE
one-piece sealing insert, not overall length insulated FPM

O-ring:

Temperature range: -60°C / +100°C

Protection class: IP 66 / IP 68

Test standard: see page 22




Category 2G: II 2G Ex eb IIC Gb

Category 2D: II 2D Ex tb IIIC Db



Zone: Gas 1 and 2 / Dust 21 and 22

Certificate: SEV 15 ATEX 0152X

IECEx Certificate: IECEx SEV 15.0019X

Approvals:   

Short entry thread metric


G	AD mm	>Ø< min mm	>Ø< max mm	 mm	H mm	L mm	Art. No.	
M12x1.5	10	4.0	6.5	15/17	33	5	EX1700.12.10.065	25
M16x1.5	14	4.5	6.0	18/21	38	5	EX1700.17.14.060	25
M16x1.5	14	6.0	8.0	18/21	38	5	EX1700.17.14.080	25
M16x1.5	14	8.5	10.5	18/21	38	5	EX1700.17.14.105	25
M20x1.5	17	6.5	8.0	24/25	38	6	EX1700.20.17.080	25
M20x1.5	17	9.5	11.0	24/25	38	6	EX1700.20.17.110	25
M20x1.5	19	6.5	8.0	24/27	39	6	EX1700.20.19.080	25
M20x1.5	19	9.5	11.0	24/27	39	6	EX1700.20.19.110	25
M20x1.5	19	12.0	15.0	24/27	39	6	EX1700.20.19.150	25
M20x1.5	21	6.5	8.0	24/29	39	6	EX1700.20.21.080	25
M20x1.5	21	9.5	11.0	24/29	39	6	EX1700.20.21.110	25
M20x1.5	21	12.0	15.0	24/29	39	6	EX1700.20.21.150	25
M25x1.5	21	10.5	12.5	30/29	43	7	EX1700.25.21.125	25
M25x1.5	21	13.0	16.0	30/29	43	7	EX1700.25.21.160	25
M25x1.5	27	10.5	12.5	30/36	50	7	EX1700.25.27.125	25
M25x1.5	27	13.0	16.0	30/36	50	7	EX1700.25.27.160	25
M25x1.5	27	17.0	20.5	30/36	50	7	EX1700.25.27.205	25
M32x1.5	27	19.0	21.0	36/36	52	8	EX1700.32.27.210	25
M40x1.5	36	25.0	28.5	45/45	56	8	EX1700.40.36.285	25
M50x1.5	45	35.0	37.0	55/54	60	9	EX1700.50.45.370	1
M63x1.5	56	44.0	46.0	70/66	67	10	EX1700.63.56.460	1

Available on request:

Long entry thread


Depending on the type of conduit, the stabilising bush must be ordered separately.

Warning: Only metallic conduits or conduits with metallic braiding may be applied!

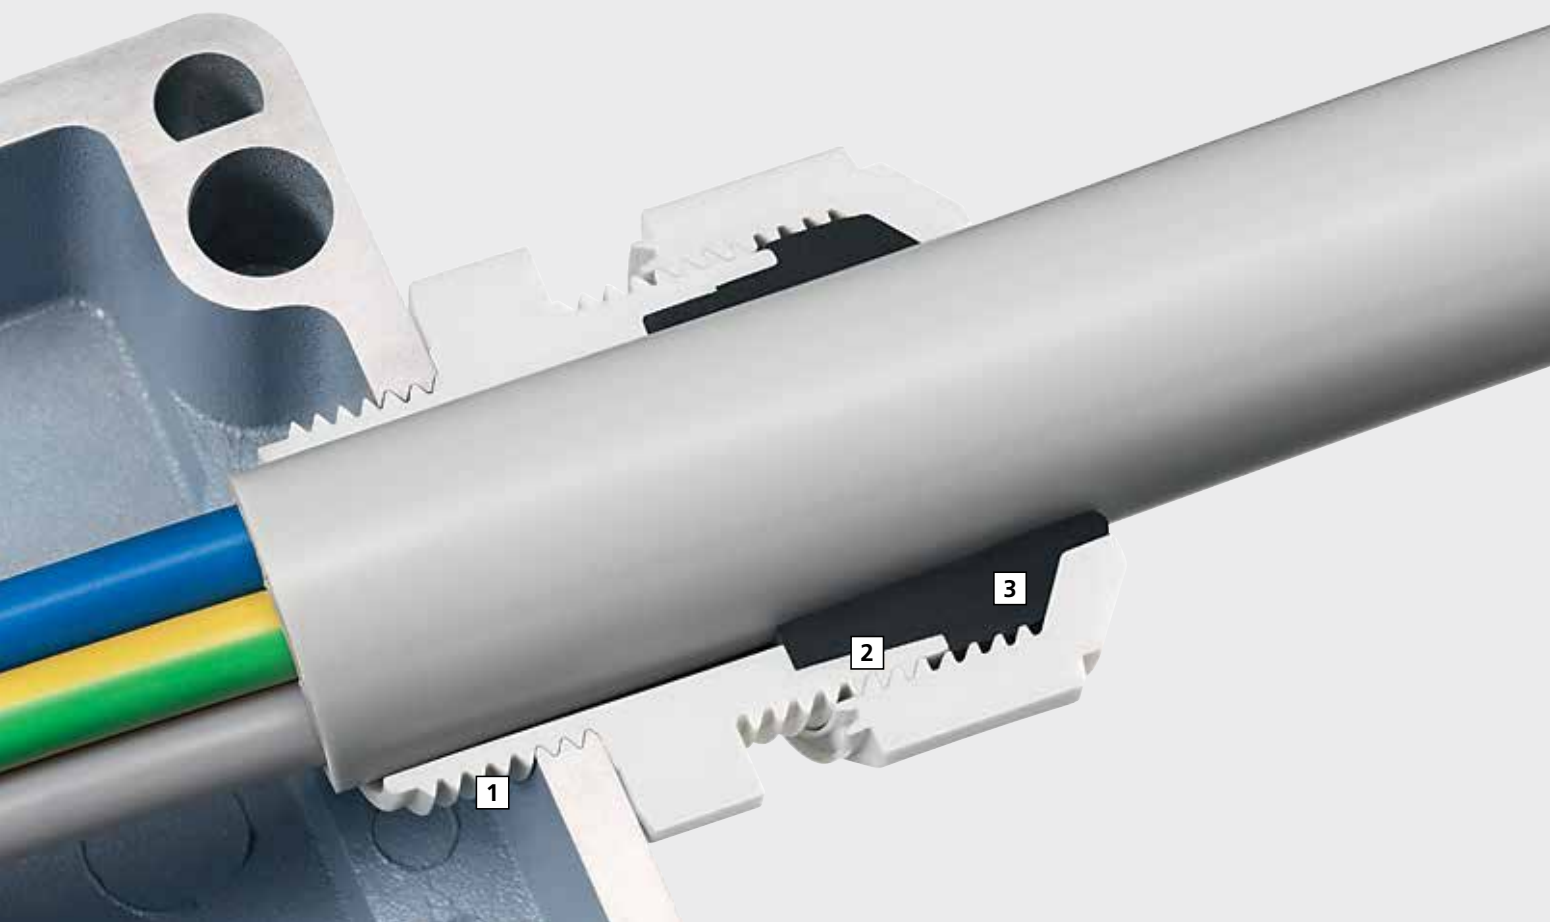

Increased safety Ex e II

Certification including ageing and climatic tests



Principle

In the case of ignition protection with an increased safety type, operation is based on the equipment preventing an ignition of the explosive atmosphere which can also leak into the housing. The equipment may not reach temperatures which are above the temperature class of gases which could potentially arise in the place of use, and sparks caused by electrical or mechanical means may also not occur. This applies not only to normal operation but also during predictable malfunctions. In electrical machines, electrical-thermal testing is thus of particular importance. In operation, protection against overloading is essentially important to maintaining explosion protection.

Important design parameters

- Special protection requirements for non-insulated active components.
- Air and creepage gaps are dimensioned larger than is generally the case in industry. Special requirements apply to the IP protection classes which must be maintained.
- More stringent requirements apply to windings with mechanical stability and insulating capacity, and the windings must be protected against elevated temperatures.

Applications

Installation materials such as junction boxes and distribution boxes, terminal compartments for heaters, storage batteries, transformers, inductive ballasts, electrical motors, squirrel cage induction motors, lighting fixtures.

Cable glands for increased safety are tested according to IEC/EN 60079-7 for the following points:

- mechanical design
- electrical-thermal testing

1 Entry threads

Progress® cable glands with entry threads in metric or Pg designs can be used with existing threads or, in the case of drilled through holes, with locknuts.

2 High distortion protection


The integrated retaining grooves in the lower part and in the sealing insert ensure protection against twisting.





3 Guaranteed sealing capability

Inner contours matched to the sealing insert ensure a targeted deformation of the insert and guarantee a perfect seal.

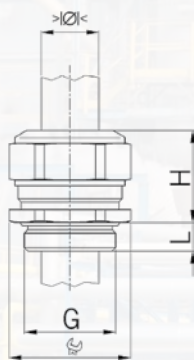

Certified according to

EN 60079-0:2012 + A11:2013 and IEC 60079-0:2011 (Ed. 6)
 EN 60079-7:2015 and IEC 60079-7:2015 (Ed. 5)
 EN 60079-31:2014 and IEC 60079-31:2013 (Ed. 2)





Designation:	Progress GFK EX
Material:	Polyamide glass fibre reinforced
Colour:	light grey RAL 7035
Properties:	halogen-free
Seal:	TPE / NBR
	one-piece sealing insert, not overall length insulated
Temperature range:	-20°C / +85°C
Protection class:	IP 66 / IP68
Test standard:	see page 24
Category 2G:	II 2G Ex eb IIC Gb
Category 2D:	II 2D Ex tb IIIC Db
Zone:	Gas 1 and 2 / Dust 21 and 22
Certificate:	SEV 15 ATEX 0152X
IECEx Certificate:	IECEx SEV 15.0019X
Approvals:	   

Entry thread metric

G	>Ø< min mm	>Ø< max mm	 mm	H mm	L mm	i info	Art.no.	
M16x1.5	4.5	6.0	21	26	12	-	EX1571.17.060	50
M16x1.5	6.0	8.0	21	26	12	-	EX1571.17.080	50
M20x1.5	6.0	8.0	27	28	13	-	EX1571.20.080	50
M20x1.5	8.0	11.0	27	28	13	-	EX1571.20.110	50
M25x1.5	9.5	12.5	34	33	13	-	EX1571.25.125	25
M25x1.5	12.5	16.0	34	33	13	-	EX1571.25.160	25
M25x1.5	16.0	19.0	34	33	13	-	EX1571.25.190	25
M25x1.5	19.0	20.5	34	33	13	-	EX1571.25.205	25
M32x1.5	20.0	21.0	41	35	15	-	EX1571.32.210	25
M32x1.5	21.0	22.0	41	35	15	3	EX1571.32.220	25
M32x1.5	22.0	23.0	41	35	15	3	EX1571.32.230	25
M32x1.5	23.0	25.5	41	35	15	-	EX1571.32.255	25
M40x1.5	25.5	27.0	50	40	15	3	EX1571.40.270	10
M40x1.5	27.0	28.5	50	40	15	-	EX1571.40.285	10
M40x1.5	28.5	30.0	50	40	15	3	EX1571.40.300	10
M40x1.5	30.0	33.0	50	40	15	-	EX1571.40.330	10
M50x1.5	33.0	35.0	60	42	16	3	EX1571.50.350	10
M50x1.5	35.0	37.0	60	42	16	-	EX1571.50.370	10
M50x1.5	37.0	39.0	60	42	16	3	EX1571.50.390	10
M50x1.5	39.0	42.0	60	42	16	-	EX1571.50.420	10
M63x1.5	42.0	44.0	75	48	16	3	EX1571.63.440	5
M63x1.5	44.0	46.0	75	48	16	-	EX1571.63.460	5
M63x1.5	46.0	48.0	75	48	16	3	EX1571.63.480	5
M63x1.5	48.0	52.0	75	48	16	-	EX1571.63.520	5





3 = Material sealing insert NBR

Entry thread Pg





G	>Ø< min mm	>Ø< max mm	 mm	H mm	L mm	i info	Art.no.	
Pg 9	4.5	6.0	21	26	12	-	EX1571.09.060	50
Pg 9	6.0	8.0	21	26	12	-	EX1571.09.080	50
Pg 11	4.0	5.5	24	28	12	-	EX1571.11.055	50
Pg 11	5.5	8.5	24	28	12	-	EX1571.11.085	50
Pg 13	6.0	8.0	27	28	13	-	EX1571.13.080	50
Pg 13	8.0	11.0	27	28	13	-	EX1571.13.110	50
Pg 16	6.0	8.0	27	28	13	-	EX1571.16.080	50
Pg 16	8.0	11.0	27	28	13	-	EX1571.16.110	50
Pg 21	9.5	12.5	34	33	13	-	EX1571.21.125	25
Pg 21	12.5	16.0	34	33	13	-	EX1571.21.160	25
Pg 21	16.0	19.0	34	33	13	-	EX1571.21.190	25
Pg 21	19.0	20.5	34	33	13	-	EX1571.21.205	25
Pg 29	19.5	21.0	41	36	13	3	EX1571.29.210	25
Pg 29	21.0	23.0	41	36	13	-	EX1571.29.230	25
Pg 29	23.0	25.0	41	36	13	3	EX1571.29.250	25
Pg 29	25.0	27.5	41	36	13	-	EX1571.29.275	25
Pg 36	27.0	28.5	55	42	16	3	EX1571.36.285	10
Pg 36	28.5	30.5	55	42	16	-	EX1571.36.305	10
Pg 36	30.5	32.5	55	42	16	3	EX1571.36.325	10
Pg 36	32.5	35.0	55	42	16	-	EX1571.36.350	10
Pg 42	33.0	35.0	60	42	16	3	EX1571.42.350	10
Pg 42	35.0	37.0	60	42	16	-	EX1571.42.370	10
Pg 42	37.0	39.0	60	42	16	3	EX1571.42.390	10
Pg 42	39.0	42.0	60	42	16	-	EX1571.42.420	10
Pg 48	41.0	43.0	70	46	16	-	EX1571.48.430	5
Pg 48	43.0	45.0	70	46	16	3	EX1571.48.450	5
Pg 48	45.0	47.0	70	46	16	3	EX1571.48.470	5
Pg 48	47.0	49.0	70	46	16	-	EX1571.48.490	5

3 = Material sealing insert NBR







Designation: Progress GFK EX
Material: Polyamide glass fibre reinforced
Colour: black RAL 9005
Properties: halogen-free
Seal: TPE / NBR
one-piece sealing insert, not overall length insulated
Temperature range: -20°C / +85°C
Protection class: IP 66 / IP68
Test standard: see page 24
Category 2G: II 2G Ex eb IIC Gb
Category 2D: II 2D Ex tb IIC Db
Zone: Gas 1 and 2 / Dust 21 and 22
Certificate: SEV 15 ATEX 0152X
IECEx Certificate: IECEx SEV 15.0019X
Approvals:    

Entry thread metric


G				H	L	i	Art.no.	
	min mm	max mm	mm	mm	mm	info		
M16x1.5	4.5	6.0	21	26	12	-	EX1540.17.060	50
M16x1.5	6.0	8.0	21	26	12	-	EX1540.17.080	50
M20x1.5	6.0	8.0	27	28	13	-	EX1540.20.080	50
M20x1.5	8.0	11.0	27	28	13	-	EX1540.20.110	50
M25x1.5	9.5	12.5	34	33	13	-	EX1540.25.125	25
M25x1.5	12.5	16.0	34	33	13	-	EX1540.25.160	25
M25x1.5	16.0	19.0	34	33	13	-	EX1540.25.190	25
M25x1.5	19.0	20.5	34	33	13	-	EX1540.25.205	25
M32x1.5	20.0	21.0	41	35	15	-	EX1540.32.210	25
M32x1.5	21.0	22.0	41	35	15	3	EX1540.32.220	25
M32x1.5	22.0	23.0	41	35	15	3	EX1540.32.230	25
M32x1.5	23.0	25.5	41	35	15	-	EX1540.32.255	25
M40x1.5	25.5	27.0	50	40	15	3	EX1540.40.270	10
M40x1.5	27.0	28.5	50	40	15	-	EX1540.40.285	10
M40x1.5	28.5	30.0	50	40	15	3	EX1540.40.300	10
M40x1.5	30.0	33.0	50	40	15	-	EX1540.40.330	10
M50x1.5	33.0	35.0	60	42	16	3	EX1540.50.350	10
M50x1.5	35.0	37.0	60	42	16	-	EX1540.50.370	10
M50x1.5	37.0	39.0	60	42	16	3	EX1540.50.390	10
M50x1.5	39.0	42.0	60	42	16	-	EX1540.50.420	10
M63x1.5	42.0	44.0	75	48	16	3	EX1540.63.440	5
M63x1.5	44.0	46.0	75	48	16	-	EX1540.63.460	5
M63x1.5	46.0	48.0	75	48	16	3	EX1540.63.480	5
M63x1.5	48.0	52.0	75	48	16	-	EX1540.63.520	5





3 = Material sealing insert NBR

Entry thread Pg

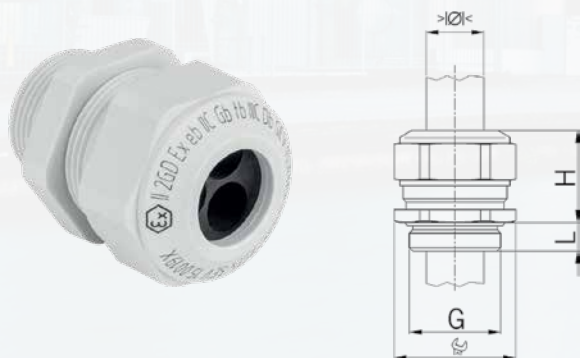


G				H	L	i	Art.no.	
	min mm	max mm	mm	mm	mm	info		
Pg 9	4.5	6.0	21	26	12	-	EX1540.09.060	50
Pg 9	6.0	8.0	21	26	12	-	EX1540.09.080	50
Pg 11	4.0	5.5	24	28	12	-	EX1540.11.055	50
Pg 11	5.5	8.5	24	28	12	-	EX1540.11.085	50
Pg 13	6.0	8.0	27	28	13	-	EX1540.13.080	50
Pg 13	8.0	11.0	27	28	13	-	EX1540.13.110	50
Pg 16	6.0	8.0	27	28	13	-	EX1540.16.080	50
Pg 16	8.0	11.0	27	28	13	-	EX1540.16.110	50
Pg 21	9.5	12.5	34	33	13	-	EX1540.21.125	25
Pg 21	12.5	16.0	34	33	13	-	EX1540.21.160	25
Pg 21	16.0	19.0	34	33	13	-	EX1540.21.190	25
Pg 21	19.0	20.5	34	33	13	-	EX1540.21.205	25
Pg 29	19.5	21.0	41	36	13	3	EX1540.29.210	25
Pg 29	21.0	23.0	41	36	13	-	EX1540.29.230	25
Pg 29	23.0	25.0	41	36	13	3	EX1540.29.250	25
Pg 29	25.0	27.5	41	36	13	-	EX1540.29.275	25
Pg 36	27.0	28.5	55	42	16	3	EX1540.36.285	10
Pg 36	28.5	30.5	55	42	16	-	EX1540.36.305	10
Pg 36	30.5	32.5	55	42	16	3	EX1540.36.325	10
Pg 36	32.5	35.0	55	42	16	-	EX1540.36.350	10
Pg 42	33.0	35.0	60	42	16	3	EX1540.42.350	10
Pg 42	35.0	37.0	60	42	16	-	EX1540.42.370	10
Pg 42	37.0	39.0	60	42	16	3	EX1540.42.390	10
Pg 42	39.0	42.0	60	42	16	-	EX1540.42.420	10
Pg 48	41.0	43.0	70	46	16	-	EX1540.48.430	5
Pg 48	43.0	45.0	70	46	16	3	EX1540.48.450	5
Pg 48	45.0	47.0	70	46	16	3	EX1540.48.470	5
Pg 48	47.0	49.0	70	46	16	-	EX1540.48.490	5

3 = Material sealing insert NBR






Designation:	Progress GFK EX
Material:	Polyamide glass fibre reinforced
Colour:	light grey 7035
Properties:	halogen-free
Seal:	TPE / NBR
	one-piece sealing insert, not overall length insulated
Temperature range:	-20°C / +85°C
Protection class:	IP 66 / IP68
Test standard:	see page 24
Category 2G:	II 2G Ex eb IIC Gb
Category 2D:	II 2D Ex tb IIIC Db
Zone:	Gas 1 and 2 / Dust 21 and 22
Certificate:	SEV 15 ATEX 0152X
IECEx Certificate:	IECEx SEV 15.0019X
Approvals:	   

Entry thread metric

G	>Ø< min mm	>Ø< max mm			H mm	L mm	i info	Art.no.	
M16x1.5	1.0	1.5	4	21	26	12	3	EX1571.17.4.015	50
M16x1.5	2.0	3.0	2	21	26	12	-	EX1571.17.2.030	50
M20x1.5	2.5	3.0	6	27	28	13	-	EX1571.20.6.030	50
M20x1.5	3.5	5.0	2	27	28	13	-	EX1571.20.2.050	50
M25x1.5	5.0	6.0	6	34	33	13	-	EX1571.25.6.060	25
M25x1.5	5.5	7.0	4	34	33	13	-	EX1571.25.4.070	25
M25x1.5	7.5	9.0	3	34	33	13	-	EX1571.25.3.090	25
M25x1.5	8.0	10.0	2	34	33	13	-	EX1571.25.2.100	25
M32x1.5	6.0	7.0	6	41	35	15	-	EX1571.32.6.070	25
M32x1.5	7.5	9.0	4	41	35	15	-	EX1571.32.4.090	25
M40x1.5	8.0	9.0	7	50	40	15	3	EX1571.40.7.090	10
M40x1.5	14.0	15.0	2	50	40	15	3	EX1571.40.2.150	10
M50x1.5	9.0	10.0	4	60	42	16	3	EX1571.50.4.100	10
M63x1.5	11.0	12.0	6	75	48	16	3	EX1571.63.6.120	5
M63x1.5	17.0	18.0	3	75	48	16	3	EX1571.63.3.180	5





3 = Material sealing insert NBR

Entry thread Pg



G	>Ø< min mm	>Ø< max mm			H mm	L mm	i info	Art.no.	
Pg 9	1.0	1.5	4	21	26	12	3	EX1571.09.4.015	50
Pg 9	2.0	3.0	2	21	26	12	-	EX1571.09.2.030	50
Pg 11	3.5	5.0	2	24	28	12	-	EX1571.11.2.050	50
Pg 11	2.0	3.0	3	24	28	12	3	EX1571.11.3.030	50
Pg 13	2.5	4.0	3	27	28	13	3	EX1571.13.3.040	50
Pg 13	3.5	5.0	2	27	28	13	-	EX1571.13.2.050	50
Pg 16	2.5	3.0	6	27	28	13	-	EX1571.16.6.030	50
Pg 16	4.5	6.0	3	27	28	13	-	EX1571.16.3.060	50
Pg 21	5.5	7.0	4	34	33	13	-	EX1571.21.4.070	25
Pg 21	7.5	9.0	3	34	33	13	-	EX1571.21.3.090	25
Pg 29	5.5	6.5	6	41	36	13	3	EX1571.29.6.065	25
Pg 29	8.0	9.0	3	41	36	13	3	EX1571.29.3.090	25
Pg 36	9.0	10.0	4	55	42	16	3	EX1571.36.4.100	10
Pg 36	14.0	15.0	2	55	42	16	3	EX1571.36.2.150	10
Pg 42	9.0	10.0	4	60	42	16	3	EX1571.42.4.100	10
Pg 48	11.0	12.0	6	70	46	16	3	EX1571.48.6.120	5
Pg 48	17.0	18.0	3	70	46	16	3	EX1571.48.3.180	5

3 = Material sealing insert NBR





Designation: Progress GFK EX
Material: Polyamide glass fibre reinforced
Colour: black RAL 9005
Properties: halogen-free
Seal: TPE / NBR
one-piece sealing insert, not overall length insulated
Temperature range: -20°C / +85°C
Protection class: IP 66 / IP68
Test standard: see page 24
Category 2G: II 2G Ex eb IIC Gb
Category 2D: II 2D Ex tb IIIC Db
Zone: Gas 1 and 2 / Dust 21 and 22
Certificate: SEV 15 ATEX 0152X
IECEx Certificate: IECEx SEV 15.0019X
Approvals:    

Entry thread metric


G	>Ø< min mm	>Ø< max mm		H mm	L mm	i info	Art.no.	
M16x1.5	1.0	1.5	4	21	26	12	3 EX1540.17.4.015	50
M16x1.5	2.0	3.0	2	21	26	12	- EX1540.17.2.030	50
M20x1.5	2.5	3.0	6	27	28	13	- EX1540.20.6.030	50
M20x1.5	3.5	5.0	2	27	28	13	- EX1540.20.2.050	50
M25x1.5	5.0	6.0	6	34	33	13	- EX1540.25.6.060	25
M25x1.5	5.0	7.0	4	34	33	13	- EX1540.25.4.070	25
M25x1.5	7.5	9.0	3	34	33	13	- EX1540.25.3.090	25
M25x1.5	8.0	10.0	2	34	33	13	- EX1540.25.2.100	25
M32x1.5	6.0	7.0	6	41	33	13	- EX1540.32.6.070	25
M32x1.5	7.5	9.0	4	41	35	15	- EX1540.32.4.090	25
M40x1.5	8.0	9.0	7	50	40	15	3 EX1540.40.7.090	10
M40x1.5	14.0	15.0	2	50	40	15	3 EX1540.40.2.150	10
M50x1.5	9.0	10.0	4	60	42	16	3 EX1540.50.4.100	10
M63x1.5	11.0	12.0	6	75	48	16	3 EX1540.63.6.120	5
M63x1.5	17.0	18.0	3	75	48	16	3 EX1540.63.3.180	5

3 = Material sealing insert NBR

Entry thread Pg

G	>Ø< min mm	>Ø< max mm		H mm	L mm	i info	Art.no.	
Pg 9	1.0	1.5	4	21	26	12	3 EX1540.09.4.015	50
Pg 9	2.0	3.0	2	21	26	12	- EX1540.09.2.030	50
Pg 11	2.0	3.0	3	24	28	12	3 EX1540.11.3.030	50
Pg 11	3.5	5.0	2	24	28	12	- EX1540.11.2.050	50
Pg 13	2.5	4.0	3	27	28	13	3 EX1540.13.3.040	50
Pg 13	3.5	5.0	2	27	28	13	- EX1540.13.2.050	50
Pg 16	2.5	3.0	6	27	28	13	- EX1540.16.6.030	50
Pg 16	4.5	6.0	3	27	28	13	- EX1540.16.3.060	50
Pg 21	5.5	7.0	4	34	33	13	- EX1540.21.4.070	25
Pg 21	7.5	9.0	3	34	33	13	- EX1540.21.3.090	25
Pg 29	5.5	6.5	6	41	36	13	3 EX1540.29.6.065	25
Pg 29	8.0	9.0	3	41	36	13	3 EX1540.29.3.090	25
Pg 36	14.0	15.0	2	55	42	16	3 EX1540.36.2.150	10
Pg 36	9.0	10.0	4	55	42	16	3 EX1540.36.4.100	10
Pg 42	9.0	10.0	4	60	42	16	3 EX1540.42.4.100	10
Pg 48	11.0	12.0	6	70	46	16	3 EX1540.48.6.120	5
Pg 48	17.0	18.0	3	70	46	16	3 EX1540.48.3.180	5

3 = Material sealing insert NBR

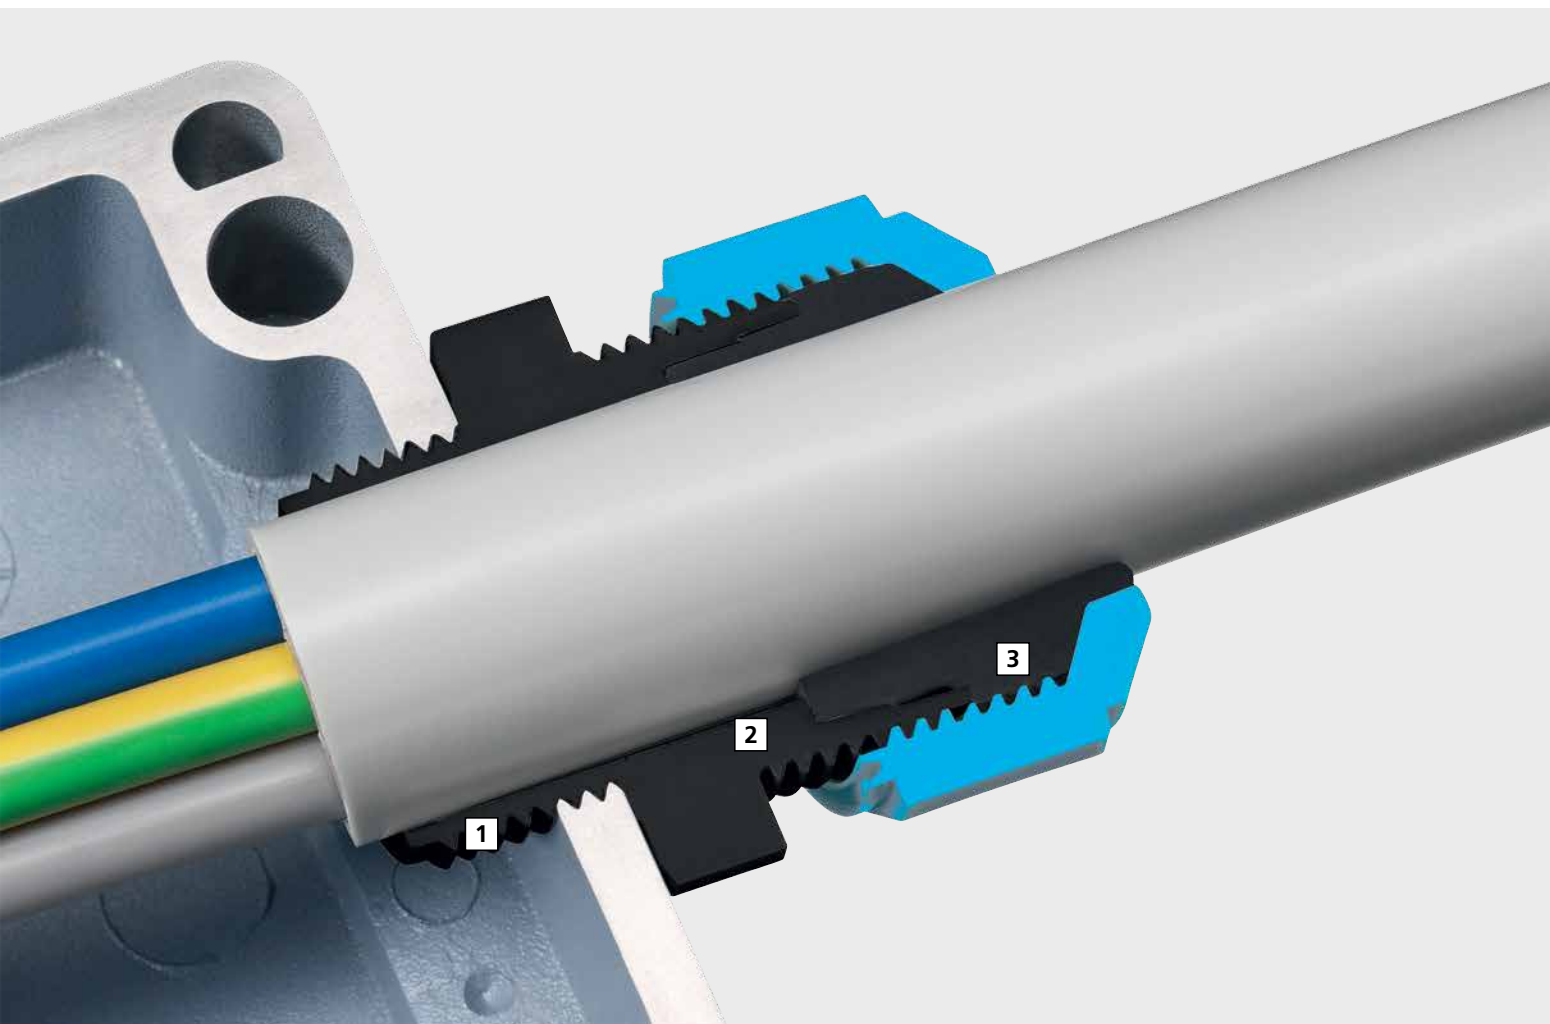

Intrinsic safety Ex i II

Certification including ageing and climatic tests



Principle

A type of ignition protection in which the equipment contains intrinsically safe electrical circuits. An electrical circuit is intrinsically safe when neither a spark nor a thermal effect can cause the ignition of a given explosive atmosphere. The conditions for undisturbed operation and certain error conditions are established in this standard.

- Different requirements apply for areas with combustible dust:
- Additional housing in Protection Class IP 6X if dust deposits can become a problem.
 - The electrical circuit must be designed for at least Explosion Group IIB.

Important design parameters

- Selection of certain components for electrical and electronic circuits.
- Reduction of the allowable loading of the components compared to normal industrial applications with regard to
 - voltage because of electrical stability
 - current with respect to heating
- The voltage and current values, including a safety factor, are continually limited to such a low level that it is certain that excessive temperatures cannot arise, while sparks and electric arcs during interruptions or short circuits have so little energy that they are unable to ignite an explosive atmosphere.

Applications

Measurement, monitoring and information systems and equipment, sensors based on physical, chemical or mechanical principles and with limited power, and actuators based on optical, acoustic and to a limited extent also on mechanical principles.

AGRO cable glands are tested for increased safety, and through the marking with the blue housing they may also be used within intrinsically safe areas i II according to IEC / EN 60079-11

- mechanical design
- electrical-thermal testing

1 Entry threads

Progress® cable glands with entry threads in metric or Pg designs can be used with existing threads or, in the case of drilled through holes, with locknuts.


2 High distortion protection

The integrated retaining grooves in the lower part and in the sealing insert ensure protection against twisting.

3 Guaranteed sealing capability
Inner contours matched to the sealing insert ensure a targeted deformation of the insert and guarantee a perfect seal.

Certified according to

- EN 60079-0:2012 + A11:2013 and IEC 60079-0:2011 (Ed. 6)
- EN 60079-7:2015 and IEC 60079-7:2015 (Ed. 5)
- EN 60079-31:2014 and IEC 60079-31:2013 (Ed. 2)

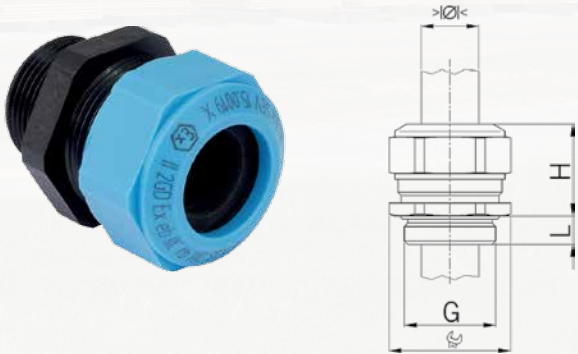

- Designation:** Progress GFK EX
Material: Polyamide glass fibre reinforced
Colour: lower part black RAL 9005
compression nut light blue RAL 5012
halogen-free
Properties:
Seal: TPE / NBR
one-piece sealing insert, not overall length insulated
Temperature range: -20°C / +85°C
Protection class: IP 66 / IP68
Test standard: see page 24
Category 2G: II 2G Ex eb IIC Gb
Category 2D: II 2D Ex tb IIIC Db
Zone: Gas 1 and 2 / Dust 21 and 22
Certificate: SEV 15 ATEX 0152X
IECEx Certificate: IECEx SEV 15.0019X
Approvals:



Entry thread metric

G	>Ø< min mm	>Ø< max mm	 mm	H mm	L mm	i info	Art.no.	
M16x1.5	4.5	6.0	21	26	12	-	EX1530.17.060	50
M16x1.5	6.0	8.0	21	26	12	-	EX1530.17.080	50
M20x1.5	6.0	8.0	27	28	13	-	EX1530.20.080	50
M20x1.5	8.0	11.0	27	28	13	-	EX1530.20.110	50
M25x1.5	9.5	12.5	34	33	13	-	EX1530.25.125	25
M25x1.5	12.5	16.0	34	33	13	-	EX1530.25.160	25
M25x1.5	16.0	19.0	34	33	13	-	EX1530.25.190	25
M25x1.5	19.0	20.5	34	33	13	-	EX1530.25.205	25
M32x1.5	20.0	21.0	41	35	15	-	EX1530.32.210	25
M32x1.5	21.0	22.0	41	35	15	3	EX1530.32.220	25
M32x1.5	22.0	23.0	41	35	15	3	EX1530.32.230	25
M32x1.5	23.0	25.5	41	35	15	-	EX1530.32.255	25
M40x1.5	25.5	27.0	50	40	15	3	EX1530.40.270	10
M40x1.5	27.0	28.5	50	40	15	-	EX1530.40.285	10
M40x1.5	28.5	30.0	50	40	15	3	EX1530.40.300	10
M40x1.5	30.0	33.0	50	40	15	-	EX1530.40.330	10
M50x1.5	33.0	35.0	60	42	16	3	EX1530.50.350	10
M50x1.5	35.0	37.0	60	42	16	-	EX1530.50.370	10
M50x1.5	37.0	39.0	60	42	16	3	EX1530.50.390	10
M50x1.5	39.0	42.0	60	42	16	-	EX1530.50.420	10
M63x1.5	42.0	44.0	75	48	16	3	EX1530.63.440	5
M63x1.5	44.0	46.0	75	48	16	-	EX1530.63.460	5
M63x1.5	46.0	48.0	75	48	16	3	EX1530.63.480	5
M63x1.5	48.0	52.0	75	48	16	-	EX1530.63.520	5

3 = Material sealing insert NBR

Available on request:
for multiple cables

Entry thread Pg

G	>Ø< min mm	>Ø< max mm	 mm	H mm	L mm	i info	Art.no.	
Pg 9	4.5	6.0	21	26	12	-	EX1530.09.060	50
Pg 9	6.0	8.0	21	26	12	-	EX1530.09.080	50
Pg 11	4.0	5.5	24	28	12	-	EX1530.11.055	50
Pg 11	5.5	8.5	24	28	12	-	EX1530.11.085	50
Pg 13	6.0	8.0	27	28	13	-	EX1530.13.080	50
Pg 13	8.0	11.0	27	28	13	-	EX1530.13.110	50
Pg 16	6.0	8.0	27	28	13	-	EX1530.16.080	50
Pg 16	8.0	11.0	27	28	13	-	EX1530.16.110	50
Pg 21	9.5	12.5	34	33	13	-	EX1530.21.125	25
Pg 21	12.5	16.0	34	33	13	-	EX1530.21.160	25
Pg 21	16.0	19.0	34	33	13	-	EX1530.21.190	25
Pg 21	19.0	20.5	34	33	13	-	EX1530.21.205	25
Pg 29	19.5	21.0	41	36	13	3	EX1530.29.210	25
Pg 29	21.0	23.0	41	36	13	-	EX1530.29.230	25
Pg 29	23.0	25.0	41	36	13	3	EX1530.29.250	25
Pg 29	25.0	27.5	41	36	13	-	EX1530.29.275	25
Pg 36	27.0	28.5	55	42	16	3	EX1530.36.285	10
Pg 36	28.5	30.5	55	42	16	-	EX1530.36.305	10
Pg 36	30.5	32.5	55	42	16	3	EX1530.36.325	10
Pg 36	32.5	35.0	55	42	16	-	EX1530.36.350	10
Pg 42	33.0	35.0	60	42	16	3	EX1530.42.350	10
Pg 42	35.0	37.0	60	42	16	-	EX1530.42.370	10
Pg 42	37.0	39.0	60	42	16	3	EX1530.42.390	10
Pg 42	39.0	42.0	60	42	16	-	EX1530.42.420	10
Pg 48	41.0	43.0	70	46	16	-	EX1530.48.430	5
Pg 48	43.0	45.0	70	46	16	3	EX1530.48.450	5
Pg 48	45.0	47.0	70	46	16	3	EX1530.48.470	5
Pg 48	47.0	49.0	70	46	16	-	EX1530.48.490	5

Accessories for Ex cable glands



Locking screws nickel-plated brass Ex d IIC

- with metric entry thread
- with Pg entry thread

Art.No. 8710.XX



Locking rings nickel-plated brass for cable glands Ex d IIC

- with metric entry thread
- with Pg entry thread

Art.No. 18XX.XX.50



Reduction fittings nickel-plated brass Ex e II

- with metric entry thread
- with Pg entry thread

Art.No. EX3500.XX.XX



Enlarging fittings nickel-plated brass Ex e II

- with metric entry thread
- with Pg entry thread

Art.no. EX3600.XX.XX



Locking screws nickel-plated brass Ex e II

- with metric entry thread
- with Pg entry thread

Art.no. EX87XX.XX.08



Locking screws synthetic Ex e II

- with metric entry thread
- with Pg entry thread

Art.no. 8841.XX.



Locknuts nickel-plated brass/synthetics

- with metric entry thread
- with Pg entry thread

8300.XX / 82XX (grey) / 82XX.40 (black)



Locking pins synthetic

- for Ex conformant closing up of unused drill holes

Certifications

IECEx Certificate of Conformity
INTERNATIONAL ELECTROTECHNICAL COMMISSION
IEC Certification Scheme for Explosive Atmospheres

Certificate No.: IECEx P18 12.0058 Issue No. 1
Status: Current
Date of Issue: 2013-03-01 Page 1 of 4
Applicant: AGRO AG, Kollerschweg 7, 8300 Hainzenau, Switzerland

Electrical Apparatus: Cable gland type 18" and Sealing Plug type 8710.XX
Optional accessory: A, N, W
Type of Protection: Ex d, Ex IIC
Marking: Ex d, Ex IIC
Approved for issue on behalf of the IECEx Certification Body: Dr.-Ing. Uwe Klotzsch

Signature: [Signature] Date: 18 FEB 2013

Certified issued by: Physikalisch-Technische Bundesanstalt (PTB), Bundesallee 115, 38110 Braunschweig, Germany

IECEx Certificate of Conformity
INTERNATIONAL ELECTROTECHNICAL COMMISSION
IEC Certification Scheme for Explosive Atmospheres

Certificate No.: IECEx P18 12.0058 Issue No. 2
Status: Current
Date of Issue: 2013-03-01 Page 1 of 3
Applicant: AGRO AG, Kollerschweg 7, 8300 Hainzenau, Switzerland

Electrical Apparatus: Cable gland type EX Compact WS, EX Compact AS and EX Compact AL
Optional accessory: A, N, W
Type of Protection: Ex d, Ex IIC
Marking: Ex d, Ex IIC
Approved for issue on behalf of the IECEx Certification Body: Dr.-Ing. Uwe Klotzsch

Signature: [Signature] Date: 18 FEB 2013

Certified issued by: Physikalisch-Technische Bundesanstalt (PTB), Bundesallee 115, 38110 Braunschweig, Germany

Physikalisch-Technische Bundesanstalt
Braunschweig und Berlin

EG-Baumusterprüfbescheinigung

(1) Geräte und Schutzkleidung zur Bekämpfung explosiver Atmosphäre
(2) EG-Baumusterprüfbescheinigung
(3) PTB 12 ATEX 1054 X
(4) Gerät: Kabelverschraubung Typ EX Compact WS, EX Compact AS und EX Compact AL
(5) Hersteller: AGRO AG
(6) Anzeiger: Kollerschweg 7, CH-8300 Hainzenau, Schweiz
(7) Die Bauteile dieser Geräte sowie die verschiedenen zugehörigen Ausführenden sind in der Anlage zu dieser Bauteileliste aufgeführt.
(8) Die Produktion dieser Bauteile ist durch die Bauteileliste der Anlage zu dieser Bauteileliste festgelegt.
(9) Die Produktion dieser Bauteile ist durch die Bauteileliste der Anlage zu dieser Bauteileliste festgelegt.
(10) Falls das Zeichen „E“ neben der Bauteileliste steht, wird auf besondere Bedingungen für die Bauteileliste hingewiesen.
(11) Diese EG-Baumusterprüfbescheinigung bescheinigt, dass die Bauteileliste der Anlage zu dieser Bauteileliste festgelegt ist.
(12) Die Bauteileliste der Anlage zu dieser Bauteileliste festgelegt ist.

Dr.-Ing. Uwe Klotzsch

electro suisse

EG-Baumusterprüfbescheinigung

(1) Geräte und Schutzkleidung zur Bekämpfung explosiver Atmosphäre
(2) EG-Baumusterprüfbescheinigung
(3) PTB 12 ATEX 1054 X
(4) Gerät: Kabelverschraubung Typ EX Compact WS, EX Compact AS und EX Compact AL
(5) Hersteller: AGRO AG
(6) Anzeiger: Kollerschweg 7, CH-8300 Hainzenau, Schweiz
(7) Die Bauteile dieser Geräte sowie die verschiedenen zugehörigen Ausführenden sind in der Anlage zu dieser Bauteileliste aufgeführt.
(8) Die Produktion dieser Bauteile ist durch die Bauteileliste der Anlage zu dieser Bauteileliste festgelegt.
(9) Die Produktion dieser Bauteile ist durch die Bauteileliste der Anlage zu dieser Bauteileliste festgelegt.
(10) Falls das Zeichen „E“ neben der Bauteileliste steht, wird auf besondere Bedingungen für die Bauteileliste hingewiesen.
(11) Diese EG-Baumusterprüfbescheinigung bescheinigt, dass die Bauteileliste der Anlage zu dieser Bauteileliste festgelegt ist.
(12) Die Bauteileliste der Anlage zu dieser Bauteileliste festgelegt ist.

Dr.-Ing. Uwe Klotzsch

IECEx Certificate of Conformity
INTERNATIONAL ELECTROTECHNICAL COMMISSION
IEC Certification Scheme for Explosive Atmospheres

Certificate No.: IECEx P18 12.0058 Issue No. 3
Status: Current
Date of Issue: 2013-03-01 Page 1 of 3
Applicant: AGRO AG, Kollerschweg 7, 8300 Hainzenau, Switzerland

Electrical Apparatus: Cable gland type EX Compact WS, EX Compact AS and EX Compact AL
Optional accessory: A, N, W
Type of Protection: Ex d, Ex IIC
Marking: Ex d, Ex IIC
Approved for issue on behalf of the IECEx Certification Body: Dr.-Ing. Uwe Klotzsch

Signature: [Signature] Date: 18 FEB 2013

Certified issued by: Physikalisch-Technische Bundesanstalt (PTB), Bundesallee 115, 38110 Braunschweig, Germany

electro suisse

EG-Baumusterprüfbescheinigung

(1) Geräte und Schutzkleidung zur Bekämpfung explosiver Atmosphäre
(2) EG-Baumusterprüfbescheinigung
(3) PTB 12 ATEX 1054 X
(4) Gerät: Kabelverschraubung Typ EX Compact WS, EX Compact AS und EX Compact AL
(5) Hersteller: AGRO AG
(6) Anzeiger: Kollerschweg 7, CH-8300 Hainzenau, Schweiz
(7) Die Bauteile dieser Geräte sowie die verschiedenen zugehörigen Ausführenden sind in der Anlage zu dieser Bauteileliste aufgeführt.
(8) Die Produktion dieser Bauteile ist durch die Bauteileliste der Anlage zu dieser Bauteileliste festgelegt.
(9) Die Produktion dieser Bauteile ist durch die Bauteileliste der Anlage zu dieser Bauteileliste festgelegt.
(10) Falls das Zeichen „E“ neben der Bauteileliste steht, wird auf besondere Bedingungen für die Bauteileliste hingewiesen.
(11) Diese EG-Baumusterprüfbescheinigung bescheinigt, dass die Bauteileliste der Anlage zu dieser Bauteileliste festgelegt ist.
(12) Die Bauteileliste der Anlage zu dieser Bauteileliste festgelegt ist.

Dr.-Ing. Uwe Klotzsch

You can find all certifications in the download area of our website www.agro.ch.

You can find our complete product line with all technical details in our catalogue and on the Internet at www.agro.ch.


Systems and solutions for professional cable entry.




Syntec® cable glands made of plastic or brass are the optimal solution for your daily installation tasks. The patented, unique lamellar technology always guarantees cable routing with excellent strain relief.



Progress® cable glands made of plastic or metal are proven aids for professional cable routing in industrial plants. The excellent compression technology ensures tight seals and strain relief which is exceptionally easy on cables.

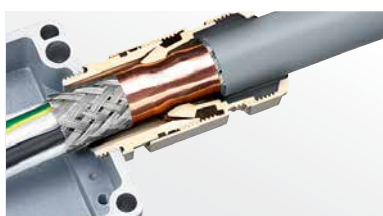

Progress® EMC cable glands made of brass ensure a low-impedance connection between the braided shield and the metal chassis while maintaining secure cable routing.

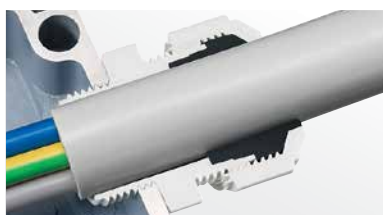

Progress® Ex cable glands made of plastic or brass ensure secure cable routing even in potentially explosive environments.



Elbows and flanges to add changes of direction in switching cabinets and chassis.



Accessories: locknuts, reduction fittings, locking screws, ...

Technical information and advice

Please find additional information about products, system solutions and communication media on our website: **www.agro.ch**

For additional questions or information our technical staff will be available and would be pleased to talk with you.

AGRO phone: +41(0) 62 889 47 47 | AGRO eMail: info@agro.ch



AGRO AG | A KAISER COMPANY

Korbackerweg 7 · CH-5502 Hunzenschwil

Phone +41(0)62 889 47 47 · Fax +41(0)62 889 47 50

www.agro.ch · info@agro.ch

AGRO
... your quality-connection